

# NK, NKG

ATEX-approved pumps

Installation and operating instructions



**NK, NKG model B, ATEX**  
Installation and operating instructions  
(all available languages)  
<http://net.grundfos.com/qr/i/96528412>



# NK, NKG

---

## English (GB)

Installation and operating instructions . . . . .	4
---	---

# English (GB) Installation and operating instructions

## Original installation and operating instructions

### Table of contents

<b>1. General information . . . . .</b>	<b>4</b>
1.1 Symbols used in this document . . . . .	4
1.2 Related installation and operating instructions . . . . .	5
<b>2. Product introduction . . . . .</b>	<b>5</b>
2.1 NK, NKG bare-shaft pumps . . . . .	5
2.2 Intended use . . . . .	5
2.3 Pumped liquids . . . . .	5
2.4 Explosion protection documentation . . . . .	5
2.5 Identification. . . . .	5
2.6 ATEX approvals. . . . .	6
<b>3. Installation requirements . . . . .</b>	<b>7</b>
3.1 Location . . . . .	7
3.2 Bypass with pressure relief valve. . . . .	7
<b>4. Electrical connection . . . . .</b>	<b>7</b>
4.1 Earthing the pump housing . . . . .	7
<b>5. Starting up the product . . . . .</b>	<b>8</b>
5.1 Before starting an ATEX-approved pump . . . . .	8
5.2 Monitoring, circulating liquid and ventilation . . . . .	9
5.3 Barrier or flushing liquid. . . . .	11
5.4 Liquid connections of dead-end solutions . . . . .	11
5.5 Circulating solution . . . . .	11
5.6 Vacuum operation or suction lift . . . . .	11
5.7 Checking the direction of rotation . . . . .	12
5.8 Monitoring of bearing condition. . . . .	12
<b>6. Servicing the product . . . . .</b>	<b>13</b>
<b>7. Technical data . . . . .</b>	<b>13</b>
7.1 Operating conditions . . . . .	13
<b>8. Disposing of the product . . . . .</b>	<b>14</b>

## 1. General information



Read this document before you install the product. Installation and operation must comply with local regulations and accepted codes of good practice.

These supplementary installation and operating instructions apply to ATEX-approved Grundfos NK, NKG pumps and NK, NKG bare-shaft pumps. The pumps comply with ATEX Directive 2014/34/EU.

## 1.1 Symbols used in this document



### DANGER

Indicates a hazardous situation which, if not avoided, will result in death or serious personal injury.



### WARNING

Indicates a hazardous situation which, if not avoided, could result in death or serious personal injury.



### CAUTION

Indicates a hazardous situation which, if not avoided, could result in minor or moderate personal injury.

The text accompanying the three hazard symbols DANGER, WARNING and CAUTION is structured in the following way:



### SIGNAL WORD

#### Description of the hazard

Consequence of ignoring the warning

- Action to avoid the hazard.



A blue or grey circle with a white graphical symbol indicates that an action must be taken.



A red or grey circle with a diagonal bar, possibly with a black graphical symbol, indicates that an action must not be taken or must be stopped.



If these instructions are not observed, it may result in malfunction or damage to the equipment.



Tips and advice that make the work easier.

## 1.2 Related installation and operating instructions

In addition to these instructions, the following installation and operating instructions must be observed:

- NK, NKG  
product number 96646512.

For special versions of the pumps, observe the relevant installation and operating instructions:

- NKG - Double seal (back-to-back)  
product number 97527932
- NKG - Double seal (tandem)  
product number 97527931.

## 2. Product introduction

### 2.1 NK, NKG bare-shaft pumps

ATEX-approved NK, NKG bare-shaft pumps are supplied with an ATEX marking similar to that of the ATEX-approved NK, NKG pump. See section Identification.

Installation and operating instructions mentioned in section Related installation and operating instructions also apply to ATEX-approved NK, NKG bare-shaft pumps.

#### Related information

- [1.2 Related installation and operating instructions](#)
- [2.5.1 Nameplate](#)

### 2.2 Intended use

The pumps are suitable for use in areas or zones classified according to Directive 2014/34/EU. In case of doubt, consult the above-mentioned directives, or contact Grundfos.

The pumps must only be operated within the specification given in the "key application data sheet".

### 2.3 Pumped liquids

The pumps are suitable for thin, clean liquids, not containing solid particles or fibres.

### 2.4 Explosion protection documentation


The combination of an NK, NKG pump and all monitoring equipment must be described in the explosion protection document according to Directive 2014/34/EU. The responsibility rests with the installer or owner.

### 2.5 Identification

#### 2.5.1 Nameplate

The nameplate on the pump head gives the following details:

- data for the standard pump
- data for the ATEX marking, pos. 1 and 2.

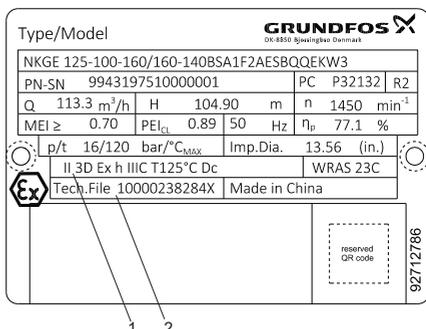

Nameplate of ATEX-approved NKG pump with single seal

Data for the ATEX marking only refers to the pump part including the coupling. The motor has a separate nameplate.

ATEX-related positions on the pump nameplate:

Pos.	Description
1	ATEX marking
II	Equipment group
2, 3	Equipment category
G	Environment:
D	Gas or vapours Combustible dust
Ex	Explosion protection
h	Type of protection
II C IIIC	Environment group: Gas or vapours Combustible dust
T4...T3	Maximum surface temperature according to 80079-36.
T125 °C	Temperature range or specific temperature.
Gb	EPL
Db	(Equipment Protection Level)
2	Technical file number
1000023 8284	Number of technical file stored at DEKRA.
X	"X" indicates that the equipment is subject to special conditions for safe use. The conditions are mentioned in this document.

TMD85618

## 2.6 ATEX approvals

### 2.6.1 Scope of ATEX categories for NK, NKG pumps


Directive		ATEX-approved NK, NKG pumps							
2014/34/EU	Equipment group	I		II					
	Equipment category	M		1		2		3	
	Environment	1	2	G	D	G	D	G	D
	EPL (Equipment Protection Level)	Ma	Mb	Ga	Da	Gb	Db	Gc	Dc
1999/92/EC	Zone			0	20	1	21	2	22
Pumps		None			NK, NKG				
Motors		None			II 2G Ex eb IIC T3 Gb II 2G Ex db IIC T4 Gb II 2G Ex db eb IIC T4 Gb		II 2D Ex tb IIC T125 °C Db	II 3G Ex ec IIC T3 Gc	II 3D Ex tc IIC T125 °C Dc

The link between groups, categories and zones is explained in Directive 2014/34/EU. Please note that this is a minimum directive. Some EU countries might therefore have stricter local rules. The user or installer is always responsible for checking that the group and category of the pump correspond to the zone classification of the installation site.


## 3. Installation requirements

### 3.1 Location

#### 3.1.1 Installation position

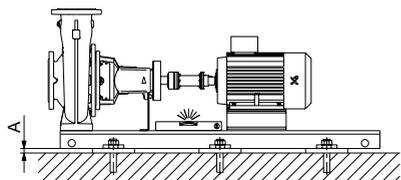

TM040488

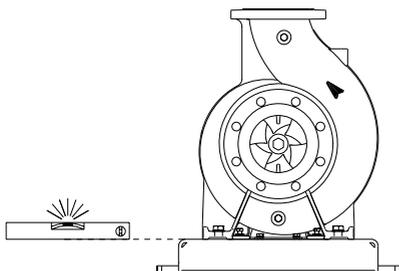

TM040489

Horizontal installation of the products

A: 19-32 mm

#### 3.1.2 Pit installation

**WARNING**  
**Accumulation of explosive gases from shaft seal leakage**

Death or serious personal injury



- Provide adequate ventilation if the pump is installed in a pit. A minimum air exchange of 1.5 times per hour is required.

### 3.2 Bypass with pressure relief valve

**CAUTION**  
**Overheating**

Minor or moderate personal injury



- The pump must not run against a closed outlet valve or a closed shut-off element as this may cause overheating. Install a bypass with a pressure relief valve.
- Observe the minimum flow rate. See section Related installation and operating instructions.

#### Related information

[1.2 Related installation and operating instructions](#)

## 4. Electrical connection

### 4.1 Earthing the pump housing



**DANGER**

**Electric shock**

Death or serious personal injury

- The pump housing must be earthed.



**DANGER**


**Ignition of explosive environment**

Death or serious personal injury

- The pump housing must be earthed.



Remove coating from the earthing point to ensure proper grounding connection.



Earthing point of the pump housing

Torque:  $80 \pm 16$  Nm.

TM052026

## 5. Starting up the product



### WARNING

#### Dry running

Death or serious personal injury

- Make sure that the pump is filled with pumped liquid during operation.

### 5.1 Before starting an ATEX-approved pump



Strictly observe the following check list.

1. Compare the order with the supplied pump and motor. Check that the EPL (Equipment Protection Level) of the pump and motor corresponds to what is ordered. If the EPL of the motor and pump differs from each other or the temperature class of the motor differs from that of the pump, the following applies:
  - The EPL which defines the lower protection level applies. Example: The EPL of the motor is Gc and the pump's is Gb. Gc applies.
  - The temperature class which defines the higher temperature applies. Example 1: Motor temperature class is T4 (135 °C), and pump temperature class is T3 (200 °C). T3 (200 °C) applies. Example 2: Motor temperature class is T3 (200 °C), and pump temperature class is T4...T3. T3 (200 °C) applies.
2. Check that the pumped liquid and its operating temperatures are in accordance with what is stated on the "key application data sheet".
3. Check that the shaft seal and rubber parts of the pump are as ordered. See the nameplate.
8. Check that the pump and/or auxiliary units have been filled with liquid and vented.
9. Check that the shaft can rotate freely. There must be no mechanical contact between the impeller and the pump housing.
10. Check the direction of rotation. The correct direction of rotation is shown by an arrow on the pump housing.
11. Follow the special startup procedures for pumps with double seal (back-to-back or tandem). See the installation and operating instructions for the pump in question.
12. If a pump with double seal (back-to-back) has been chosen, check that the seal chamber is correctly pressurised.
13. Before start and during operation, make sure that the pump does not leak or have any malfunctions.
14. The pump must be re-vented in these cases:
  - The pump has been stopped for a period of time.
  - Air or gas has accumulated in the pump.

#### Related information

[1.2 Related installation and operating instructions](#)

NKG	125-100-160 /160-142	H2	F	2	A	KE	O	2926
-----	----------------------	----	---	---	---	----	---	------

*Example of codes for rubber parts and shaft seal*

The key to the nameplate is shown in the installation and operating instructions for the standard pump.

4. Check that the maximum speed on the pump nameplate corresponds to the speed of the motor and that the pump will not be used for operation with a frequency higher than 60 Hz.
5. Check alignment of the pump and motor. Follow the procedure in the standard instructions.
6. For the oil-filled bearing bracket, check that oil is filled to the correct level. Do not use another lubricant than specified. See section Related installation and operating instructions.
7. For bearing brackets with grease nipples, check that grease can be pumped into the bearing. Do not use another lubricant than specified. The re-greasing nipple could be defective, or the re-greasing channel may be blocked.

## 5.2 Monitoring, circulating liquid and ventilation

Shaft seal arrangement	Type of unit	Solution	Type of pumped liquid	EPL	Text code <sup>4)</sup>		
Single shaft seal	Pump unit		Non-flammable	Gc/Dc	1, 10		
				Gb/Db	2, 10		
			Flammable	Gc/Dc	2, 11		
				Gb/Db	2, 11		
			Pump unit		Non-flammable	Gc/Dc	1, 10
						Gb/Db	2, 10
Flammable	Gc/Dc	2, 11					
	Gb/Db	2, 11					
Dead-end		Pressureless <sup>1)</sup>			Non-flammable	Gc/Dc	3, 10
					Gb/Db	3, 10	
		Flammable	Gc/Dc	3, 10			
			Gb/Db	4, 11			
		Double shaft seal	Auxiliary unit	Pressurised <sup>2)</sup>	Non-flammable	Gc/Dc	5, 10
					Gb/Db	6, 10	
Flammable	Gc/Dc			5, 11			
	Gb/Db			6, 11			
Circulating <sup>3)</sup>	Pressureless <sup>1)</sup>			Non-flammable	Gc/Dc	3, 7, 10	
				Gb/Db	3, 7, 10		
	Flammable	Gc/Dc	4, 8, 11				
		Gb/Db	4, 8, 11				
	Pressurised <sup>2)</sup>	Non-flammable	Gc/Dc	5, 7, 10			
		Gb/Db	6, 8, 10				
Flammable	Gc/Dc	5, 7, 11					
	Gb/Db	6, 8, 11					

<sup>1)</sup> Pressureless: The pumped liquid will continuously leak into the auxiliary system liquid, the maximum leakage is 1.5 ml per hour, and may fill the auxiliary system.

<sup>2)</sup> Pressurised: The barrier liquid will continuously leak into the pumped liquid, the maximum leakage is 1.5 ml per hour. The liquids must be compatible.

<sup>3)</sup> Circulating: circulating liquid.

A temperature increase of 7-10 K across the shaft seal chamber and a maximum outlet temperature of 70 °C must be maintained. This ensures correct function of the shaft seals.

If circulation is lost, the temperature of the barrier or flushing liquid will increase.

<sup>4)</sup> See the table below for text code descriptions.

<b>Text code</b>	<b>Description</b>
<b>Monitoring</b>	
1	No additional monitoring, for example dry-running protection, is required for the pump system.
2	If the operator cannot ensure that the pump is filled with pumped liquid during operation, appropriate monitoring, for instance dry-running protection, is required to stop the pump in case of malfunction.
3	No additional monitoring, for example dry-running protection, is required for the auxiliary unit.
4	If the operator cannot ensure that the auxiliary unit is filled with barrier or flushing liquid during operation, appropriate monitoring, for instance a level switch, is required to give an alarm in case of malfunction.
5	In case of a drop in barrier liquid pressure, a warning must be given. Check the system and remedy.
6	In case of a drop in barrier liquid pressure, an alarm must be given, and the system must shut down if the barrier liquid pressure is not brought back to the correct pressure level.
<b>Circulating liquid</b>	
7	If circulation of the barrier or flushing liquid is lost, a warning must be given. Check the system and remedy.
8	If circulation of the barrier or flushing liquid is lost, an alarm must be given. Check the system and remedy. The system must shut down if the circulation cannot be re-established during operation.
<b>Ventilation</b>	
10	Ventilation around the pump is not required.
11	The leakage rate of a normally working shaft seal is less than 36 ml for each 24 hours of operation. Ventilation around the pump is required. The minimum air exchange is 1.5 times per hour.

**CAUTION****Flammable material**

Minor or moderate personal injury




- The responsibility for checking the functions of the dry-running protection, such as flow rate, sealing pressure and temperature of the barrier or flushing liquid, rests with the installer or owner.

### 5.3 Barrier or flushing liquid

Barrier or flushing liquid must have an auto-ignition temperature which is at least 50 K higher than the maximum surface temperature of the pump.

### 5.4 Liquid connections of dead-end solutions

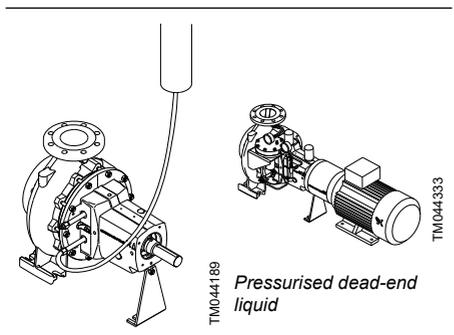


Pressureless dead-end liquid

#### Examples of double seal arrangements with dead-end solutions




For the examples as shown in the figure below, the liquid must be connected to pipe connection number 2 in the figure below. Pipe connections 1 and 3 must be plugged.

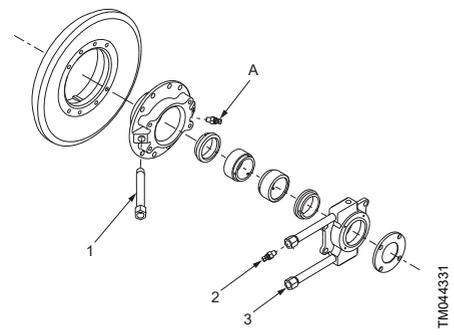

Pipe connections

### 5.5 Circulating solution

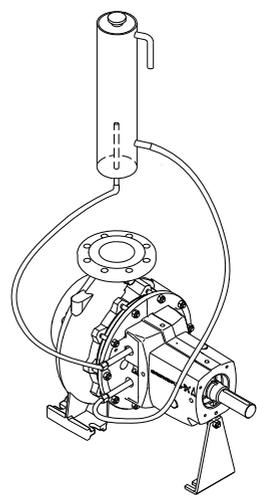


Example of circulating solution

Important operating parameter for the circulating solution:

At all times, the maximum discharge temperature from the seal chamber must be kept below 70 °C, and optimally maximum 60 °C.

Delta T across the seal chamber is adjusted and set between 7 and maximum 10 K.

### 5.6 Vacuum operation or suction lift

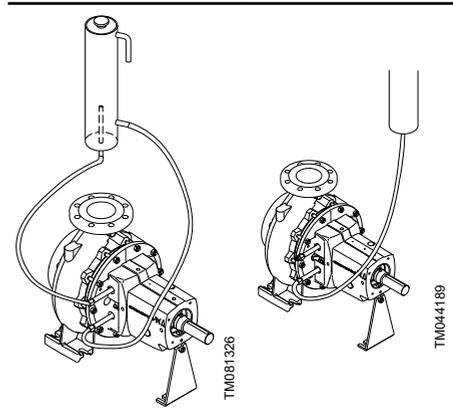

Pumps with double seal arrangements connected to an elevated vessel

If vacuum operation or suction lift is a continuous or periodic operating condition for the applications shown in the figure above, use appropriate level monitoring equipment to ensure liquid in the seal chamber. The pump must be stopped if the liquid reaches a specified low level in the supply vessel.

### 5.7 Checking the direction of rotation



Never check the direction of rotation by starting the pump, not even for a short period, unless the pump and auxiliary unit have been filled with liquid. This is to prevent temperature rises resulting from contact between rotating and stationary components, and to protect the shaft seal against dry running.


### 5.8 Monitoring of bearing condition

For EPL Gb/Db and Gc/Dc, bearing condition monitoring is basically not needed as failure of the bearings is considered a rare malfunction. However, local regulations may call for stricter measures with continuous monitoring of the bearing condition.

#### 5.8.1 SPM nipples

For bearing brackets with grease nipples or constant-level oiler, SPM nipples are an option for vibration measurement. Through regular shock-pulse measurement, the development of incipient damage can be monitored.

The measuring point is located in the load zone of the bearing.

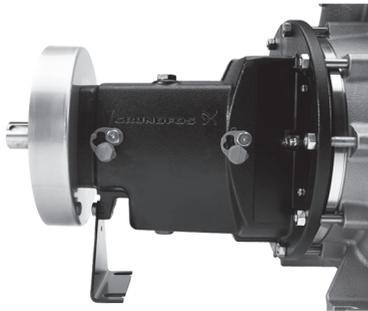

TM081241

*SPM fitting in the bearing bracket*

To monitor the bearing condition, the initial vibration level, dBi (decibel initial), must be measured. It constitutes the starting point of the condition scale for a particular bearing.


If the vibration level develops faster than it did in the first two to three months of operation, renew the bearings.

If the vibration level develops fast, also observe for other operating conditions which could cause increased vibration levels.

#### 5.8.2 Mounting of sensors or transmitters

Bearing brackets with grease nipples or constant-level oiler are optionally supplied with pre-machined tappings prepared for temperature sensors or transmitters.

Thus, it becomes possible to continuously measure the temperature development of the bearings.

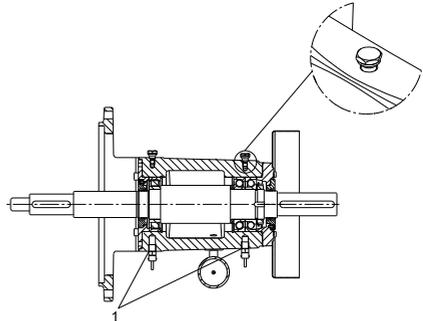

TM074995

*Optional tappings prepared for fitting of temperature sensors or transmitters*

Pos.	Description
1	Tappings for sensors

The alarm level is the maximum surface temperature detected by the bearing temperature sensor. The temperature alarm level is set 65 K above ambient temperature, but must be lower than the temperature classification for the area. Logging interval must be set to every 10th sec.

If the alarm level is reached, the system must be stopped. The protection system must lock the pump till it is manually restarted.

## 6. Servicing the product

Service on the pump end can be made on site. The pump end does not need to be shipped to an approved ATEX workshop.



Strictly observe the following check list. It may be overruled by stricter local maintenance schedules.

1. Check on a daily basis that the shaft seal and auxiliary units function correctly.
2. Check for oil leakage around the bearing shaft daily. If there is any oil spillage on the shaft packings, it may be due to one of the following reasons:
  - The bearing bracket is overfilled.
  - The breathing hole in the filling plug is blocked.
  - The shaft packing is defective.
3. Check the lubricant and bearing noise each week. If the bearings begin to show signs of wear, they must be replaced. Under optimum operating conditions, the operating life of the bearings can reach its designed life. After that period, we recommend replacing the bearings.
4. Check coupling rubber parts every four weeks. If they begin to show signs of wear, they must be replaced, and alignment of the pump must be checked.
5. Inspect O-rings for cracks, elasticity, and permanent change of shape when doing periodic maintenance or servicing the pump. Replace if necessary.
6. It is the responsibility of the customer to do the following:
  - Decide whether to use the non-sparking tools or to shut down the system for service.
  - Lay down a cleaning scheme for pump surfaces when you install it in a combustible dust environment.
7. When cleaning a pump located in a combustible dust environment, remember to take the shaft guard and coupling guard off, and clean these cavities.
8. Any standby pump installed must be switched on once a week to keep it operational.
9. The pressurising or flushing system must be thoroughly cleaned once a year. Read the manufacturer's instructions for the auxiliary unit. Take the pump out of operation for this purpose.
10. Torques for all fasteners can be found in the service instructions for NK, NKG pumps.

## 7. Technical data


### 7.1 Operating conditions

#### 7.1.1 Liquid temperature

The maximum liquid temperature depends on the temperature class specified by the customer and the shaft seal.

Temperature class	Maximum surface temperature [°C]
T1	450
T2	300
T3	200
T4	135
T5	100
T6	85

The illustration below shows the maximum surface temperature of the pump as a result of maximum liquid temperature and temperature rise in the shaft seal.

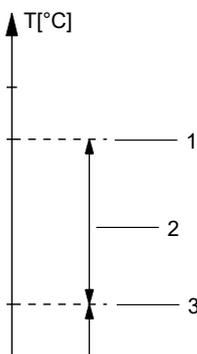

Calculation of maximum surface temperature

Pos.	Description
1	Maximum surface temperature of the pump
2	Temperature rise in the shaft seal (determined by Grundfos)
3	Maximum liquid temperature

The maximum surface temperature of the pump must be at least 5 °C lower than the maximum surface temperature of the temperature class specified by the customer.

TM081289

The maximum liquid temperature and the temperature class specified by the customer are stated on the "key application data sheet" supplied with the pump. See the example at the end of this document.

A copy is filed by Grundfos and can be traced by means of the product number and serial numbers on the pump nameplate.

Model 

B   96689648 P2 07 02 0001
----------------------------

TM067167

*Model, product number, production site, year, week, and serial number*



Do not exceed the maximum liquid temperature or pump another type of liquid than specified on the "key application data sheet" supplied with the pump. Damage resulting from disregarding this warning will not be covered by the Grundfos warranty.



If the "key application data sheet" is missing, contact Grundfos for information about the maximum liquid temperature.

If the pump is to be operated at a higher liquid temperature or with another liquid than the one stated on the data sheet, contact Grundfos.

### 7.1.2 Ambient temperature

The ambient temperature range in operation is -20 to +60 °C for the pump-end.

## 8. Disposing of the product

This product or parts of it must be disposed of in an environmentally sound way.

1. Use the public or private waste collection service.
2. If this is not possible, contact the nearest Grundfos company or service workshop.



The crossed-out wheellie bin symbol on a product means that it must be disposed of separately from household waste. When a product marked with this symbol reaches its end of life, take it to a collection point designated by the local waste disposal authorities. The separate collection and recycling of such products will help protect the environment and human health.

See also end-of-life information at [www.grundfos.com/product-recycling](http://www.grundfos.com/product-recycling).

**Argentina**

Bombas GRUNDFOS de Argentina S.A.  
Ruta Panamericana km. 37.500 Industrias  
1619 - Garin Pcia. de B.A.  
Tel.: +54-3327 414 444  
Fax: +54-3327 45 3190

**Australia**

GRUNDFOS Pumps Pty. Ltd.  
P.O. Box 2040  
Regency Park  
South Australia 5942  
Tel.: +61-8-8461-4611  
Fax: +61-8-8340-0155

**Austria**

GRUNDFOS Pumpen Vertrieb  
Ges.m.b.H.  
Grundfosstraße 2  
A-5082 Grödig/Salzburg  
Tel.: +43-6246-883-0  
Fax: +43-6246-883-30

**Belgium**

N.V. GRUNDFOS Bellux S.A.  
Boomssesteenweg 81-83  
B-2630 Aartselaar  
Tel.: +32-3-870 7300  
Fax: +32-3-870 7301

**Bosnia and Herzegovina**

GRUNDFOS Sarajevo  
Zmaja od Bosne 7-7A  
BiH-71000 Sarajevo  
Tel.: +387 33 592 480  
Fax: +387 33 590 465  
www.ba.grundfos.com  
E-mail: grundfos@bih.net.ba

**Brazil**

BOMBAS GRUNDFOS DO BRASIL  
Av. Humberto de Alencar Castelo  
Branco, 630  
CEP 09850 - 300  
São Bernardo do Campo - SP  
Tel.: +55-11 4393 5533  
Fax: +55-11 4343 5015

**Bulgaria**

Grundfos Bulgaria EOOD  
Slatina District  
Iztocna Tangenta street no. 100  
BG - 1592 Sofia  
Tel.: +359 2 49 22 200  
Fax: +359 2 49 22 201  
E-mail: bulgaria@grundfos.bg

**Canada**

GRUNDFOS Canada inc.  
2941 Brighton Road  
Oakville, Ontario  
L6H 6C9  
Tel.: +1-905 829 9533  
Fax: +1-905 829 9512

**China**

GRUNDFOS Pumps (Shanghai) Co. Ltd.  
10F The Hub, No. 33 Suhong Road  
Minhang District  
Shanghai 201106 PRC  
Tel.: +86 21 612 252 22  
Fax: +86 21 612 253 33

**Columbia**

GRUNDFOS Colombia S.A.S.  
Km 1.5 vía Siberia-Cota Conj. Potrero  
Chico,  
Parque Empresarial Arcos de Cota Bo. 1A.  
Cota, Cundinamarca  
Tel.: +57(1)-2913444  
Fax: +57(1)-8764586

**Croatia**

GRUNDFOS CROATIA d.o.o.  
Buzinski prilaz 38, Buzin  
HR-10010 Zagreb  
Tel.: +385 1 6595 400  
Fax: +385 1 6595 499  
www.hr.grundfos.com

**Czech Republic**

GRUNDFOS Sales Czechia and Slovakia  
s.r.o.  
Čajkovského 21  
779 00 Olomouc  
Tel.: +420-585-716 111

**Denmark**

GRUNDFOS DK A/S  
Martin Bachs Vej 3  
DK-8850 Bjerringbro  
Tel.: +45-87 50 50 50  
Fax: +45-87 50 51 51  
E-mail: info\_GDK@grundfos.com  
www.grundfos.com/DK

**Estonia**

GRUNDFOS Pumps Eestli OÜ  
Peterburi tee 92G  
11415 Tallinn  
Tel.: + 372 606 1690  
Fax: + 372 606 1691

**Finland**

OY GRUNDFOS Pumput AB  
Trukkikujua 1  
FI-01360 Vantaa  
Tel.: +358-(0) 207 889 500

**France**

Pompes GRUNDFOS Distribution S.A.  
Parc d'Activités de Chesnes  
57, rue de Malacombe  
F-38290 St. Quentin Fallavier (Lyon)  
Tel.: +33-4 74 82 15 15  
Fax: +33-4 74 94 10 51

**Germany**

GRUNDFOS GMBH  
Schlüterstr. 33  
40699 Erkrath  
Tel.: +49-(0) 211 929 69-0  
Fax: +49-(0) 211 929 69-3799  
E-mail: infoservice@grundfos.de  
Service in Deutschland:  
kundendienst@grundfos.de

**Greece**

GRUNDFOS Hellas A.E.B.E.  
20th km. Athinon-Markopoulou Av.  
P.O. Box 71  
GR-19002 Peania  
Tel.: +0030-210-66 83 400  
Fax: +0030-210-66 46 273

**Hong Kong**

GRUNDFOS Pumps (Hong Kong) Ltd.  
Unit 1, Ground floor, Siu Wai industrial  
Centre  
29-33 Wing Hong Street & 68 King Lam  
Street, Cheung Sha Wan  
Kowloon  
Tel.: +852-27861706 / 27861741  
Fax: +852-27858664

**Hungary**

GRUNDFOS Hungária Kft.  
Tópark u. 8  
H-2045 Törökbalint  
Tel.: +36-23 511 110  
Fax: +36-23 511 111

**India**

GRUNDFOS Pumps india Private Limited  
118 Old Mahabalipuram Road  
Thoraipakkam  
Chennai 600 097  
Tel.: +91-44 2496 6800

**Indonesia**

PT GRUNDFOS Pompa  
Graha intrub Lt. 2 & 3  
Jl. Cililitan Besar No.454. Makasar,  
Jakarta Timur  
ID-Jakarta 13650  
Tel.: +62 21-469-51900  
Fax: +62 21-460 6910 / 460 6901

**Ireland**

GRUNDFOS (Ireland) Ltd.  
Unit A, Merrywell Business Park  
Ballymount Road Lower  
Dublin 12  
Tel.: +353-1-4089 800  
Fax: +353-1-4089 830

**Italy**

GRUNDFOS Pompe Italia S.r.l.  
Via Gran Sasso 4  
I-20060 Truccazzano (Milano)  
Tel.: +39-02-95838112  
Fax: +39-02-95309290 / 95838461

**Japan**

GRUNDFOS Pumps K.K.  
1-2-3, Shin-Miyakoda, Kita-ku  
Hamamatsu  
431-2103 Japan  
Tel.: +81 53 428 4760  
Fax: +81 53 428 5005

**Kazakhstan**

Grundfos Kazakhstan LLP  
7' Kyz-Zhibek Str., Kok-Tobe micr.  
KZ-050020 Almaty Kazakhstan  
Tel.: +7 (727) 227-98-55/56

**Korea**

GRUNDFOS Pumps Korea Ltd.  
6th Floor, Aju Building 679-5  
Yeoksam-dong, Kangnam-ku, 135-916  
Seoul, Korea  
Tel.: +82-2-5317 600  
Fax: +82-2-5633 725

**Latvia**

SIA GRUNDFOS Pumps Latvia  
Deglava biznesa centrs  
Augusta Deglava ielā 60  
LV-1035, Rīga,  
Tel.: + 371 714 9640, 7 149 641  
Fax: + 371 914 9646

**Lithuania**

GRUNDFOS Pumps UAB  
Smolensko g. 6  
LT-03201 Vilnius  
Tel.: +370 52 395 430  
Fax: +370 52 395 431

**Malaysia**

GRUNDFOS Pumps Sdn. Bhd.  
7 Jalan Peguam U1/25  
Glenmarie Industrial Park  
40150 Shah Alam, Selangor  
Tel.: +60-3-5569 2922  
Fax: +60-3-5569 2866

**Mexico**

Bombas GRUNDFOS de México  
S.A. de C.V.  
Boulevard TLC No. 15  
Parque industrial Stiva Aeropuerto  
Apodaca, N.L. 66600  
Tel.: +52-81-8144 4000  
Fax: +52-81-8144 4010

**Netherlands**

GRUNDFOS Netherlands  
Veluwezoom 35  
1326 AE Almere  
Postbus 22015  
1302 CA ALMERE  
Tel.: +31-88-478 6336  
Fax: +31-88-478 6332  
E-mail: info\_gnl@grundfos.com

**New Zealand**

GRUNDFOS Pumps NZ Ltd.  
17 Beatrice Tinsley Crescent  
North Harbour Industrial Estate  
Albany, Auckland  
Tel.: +64-9-415 3240  
Fax: +64-9-415 3250

**Norway**

GRUNDFOS Pumper A/S  
Strømsveien 344  
Postboks 235, Leirdal  
N-1011 Oslo  
Tel.: +47-22 90 47 00  
Fax: +47-22 32 21 50

**Poland**

GRUNDFOS Pompy Sp. z o.o.  
ul. Klonowa 23  
Baranowo k. Poznania  
PL-62-081 Przeźmierowo  
Tel.: (+48-61) 650 13 00  
Fax: (+48-61) 650 13 50

**Portugal**

Bombas GRUNDFOS Portugal, S.A.  
Rua Calvet de Magalhães, 241  
Apartado 1079  
P-2770-153 Paço de Arcos  
Tel.: +351-21-440 76 00  
Fax: +351-21-440 76 90

**Romania**

GRUNDFOS Pompe România SRL  
S-PARK BUSINESS CENTER, Clădirea  
A2, etaj 2  
Str. Tipografilor, Nr. 11-15, Sector 1, Cod  
013714  
Bucuresti, Romania  
Tel.: 004 021 2004 100  
E-mail: romania@grundfos.ro

**Serbia**

Grundfos Srbija d.o.o.  
Ormladinskih brigada 90b  
11070 Novi Beograd  
Tel.: +381 11 2258 740  
Fax: +381 11 2281 769  
www.rs.grundfos.com

**Singapore**

GRUNDFOS (Singapore) Pte. Ltd.  
25 Jalan Tukang  
Singapore 619264  
Tel.: +65-6681 9688  
Fax: +65-6681 9689

**Slovakia**

GRUNDFOS s.r.o.  
Prievozská 4D 821 09 BRATISLAVA  
Tel.: +421 2 5020 1426  
sk.grundfos.com

**Slovenia**

GRUNDFOS LJUBLJANA, d.o.o.  
Leskoškova 9e, 1122 Ljubljana  
Tel.: +386 (0) 1 568 06 10  
Fax: +386 (0) 1 568 06 19  
E-mail: tehnika-si@grundfos.com

**South Africa**

GRUNDFOS (PTY) LTD  
16 Lascelles Drive, Meadowbrook Estate  
1609 Germiston, Johannesburg  
Tel.: (+27) 10 248 6000  
Fax: (+27) 10 248 6002  
E-mail: lgradidge@grundfos.com

**Spain**

Bombas GRUNDFOS España S.A.  
Camino de la Fuentecilla, s/n  
E-28110 Algete (Madrid)  
Tel.: +34-91-848 8800  
Fax: +34-91-628 0465

**Sweden**

GRUNDFOS AB  
Box 333 (Lunnagårdsgatan 6)  
431 24 Mölndal  
Tel.: +46 31 332 23 000  
Fax: +46 31 331 94 60

**Switzerland**

GRUNDFOS Pumpen AG  
Bruggacherstrasse 10  
CH-8117 Fällanden/ZH  
Tel.: +41-44-806 8111  
Fax: +41-44-806 8115

**Taiwan**

GRUNDFOS Pumps (Taiwan) Ltd.  
7 Floor, 219 Min-Chuan Road  
Taichung, Taiwan, R.O.C.  
Tel.: +886-4-2305 0868  
Fax: +886-4-2305 0878

**Thailand**

GRUNDFOS (Thailand) Ltd.  
92 Chaloe Phrakiat Rama 9 Road  
Dokmai, Pravej, Bangkok 10250  
Tel.: +66-2-725 8999  
Fax: +66-2-725 8998

**Turkey**

GRUNDFOS POMPA San. ve Tic. Ltd.  
Sti.  
Gebze Organize Sanayi Bölgesi  
Ihsan dede Caddesi  
2. yol 200, Sokak No. 204  
41490 Gebze/ Kocaeli  
Tel.: +90 - 262-679 7979  
Fax: +90 - 262-679 7905  
E-mail: satis@grundfos.com

**Ukraine**

ТОВ "ГРУНДФОС УКРАЇНА"  
Бізнес Центр Європа  
Столичне шосе, 103  
м. Київ, 03131, Україна  
Tel.: (+38 044) 237 04 00  
Fax: (+38 044) 237 04 01  
E-mail: ukraine@grundfos.com

**United Arab Emirates**

GRUNDFOS Gulf Distribution  
P.O. Box 16768  
Jebel Ali Free Zone, Dubai  
Tel.: +971 4 8815 166  
Fax: +971 4 8815 136

**United Kingdom**

GRUNDFOS Pumps Ltd.  
Grovebury Road  
Leighton Buzzard/Beds. LU7 4TL  
Tel.: +44-1525-850000  
Fax: +44-1525-850011

**U.S.A.**

Global Headquarters for WU  
856 Koomey Road  
Brookshire, Texas 77423 USA  
Phone: +1-630-236-5500

**Uzbekistan**

Grundfos Tashkent, Uzbekistan  
The Representative Office of Grundfos  
Kazakhstan in Uzbekistan  
38a, Oybek street, Tashkent  
Tel.: (+998) 71 150 3290 / 71 150 3291  
Fax: (+998) 71 150 3292

<b>96528412</b> 12.2023
-------------------------

ECM: 1383319
--------------

[www.grundfos.com](http://www.grundfos.com)

**GRUNDFOS** 