
DME, A (2-48 l/h)

Installation and operating instructions

GB D F I E P GR NL S FIN DK



GB Declaration of Conformity

We, Grundfos Aldos, declare under our sole responsibility that the products DME, to which this declaration relates, are in conformity with these Council directives on the approximation of the laws of the EC member states:

- Machinery Directive (2006/42/EC).
Standards used: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009
- Low Voltage Directive (2006/95/EC).
Standard used: EN 60204-1+A1: 2009.
- EMC Directive (2004/108/EC).
Standards used: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

DE Konformitätserklärung

Wir, Grundfos, erklären in alleiniger Verantwortung, dass die Produkte DME, auf die sich diese Erklärung bezieht, mit den folgenden Richtlinien des Rates zur Angleichung der Rechtsvorschriften der EU-Mitgliedsstaaten übereinstimmen:

- Maschinenrichtlinie (2006/42/EG).
Normen, die verwendet wurden: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Niederspannungsrichtlinie (2006/95/EG).
Norm, die verwendet wurde: EN 60204-1+A1: 2009.
- EMV-Richtlinie (2004/108/EG).
Normen, die verwendet wurden: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

ES Declaración de Conformidad

Nosotros, Grundfos, declaramos bajo nuestra entera responsabilidad que los productos DME, a los cuales se refiere esta declaración, están conformes con las Directivas del Consejo en la aproximación de las leyes de los Estados Miembros del EM:

- Directiva de Maquinaria (2006/42/CE).
Normas aplicadas: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Directiva de Baja Tensión (2006/95/CE).
Norma aplicada: EN 60204-1+A1: 2009.
- Directiva EMC (2004/108/CE).
Normas aplicadas: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

IT Dichiarazione di Conformità

Grundfos dichiara sotto la sua esclusiva responsabilità che i prodotti DME, ai quali si riferisce questa dichiarazione, sono conformi alle seguenti direttive del Consiglio riguardanti il riavvicinamento delle legislazioni degli Stati membri CE:

- Direttiva Macchine (2006/42/CE).
Norme applicate: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Direttiva Bassa Tensione (2006/95/CE).
Norma applicata: EN 60204-1+A1: 2009.
- Direttiva EMC (2004/108/CE).
Norme applicate: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

PT Declaração de Conformidade

A Grundfos declara sob sua única responsabilidade que os produtos DME, aos quais diz respeito esta declaração, estão em conformidade com as seguintes Directivas do Conselho sobre a aproximação das legislações dos Estados Membros da CE:

- Directiva Máquinas (2006/42/CE).
Normas utilizadas: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Directiva Baixa Tensão (2006/95/CE).
Norma utilizada: EN 60204-1+A1: 2009.
- Directiva EMC (compatibilidade electromagnética) (2004/108/CE).
Normas utilizadas: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

SE Försäkrar om överensstämmelse

Vi, Grundfos, försäkrar under ansvar att produkterna DME, som omfattas av denna försäkrar, är i överensstämmelse med rådets direktiv om inbördes närmande till EU-medlemsstaternas lagstiftning, avseende:

- Maskindirektivet (2006/42/EG).
Tillämpade standarder: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Lågspänningsdirektivet (2006/95/EG).
Tillämpad standard: EN 60204-1+A1: 2009.
- EMC-direktivet (2004/108/EG).
Tillämpade standarder: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

DK Overensstemmelseerklæring

Vi, Grundfos, erklærer under ansvar at produkterne DME som denne erklæring omhandler, er i overensstemmelse med disse af Rådets direktiver om indbyrdes tilnærmede til EF-medlemsstaternes lovgivning:

- Maskindirektivet (2006/42/EF).
Anvendt standarder: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Lavspændingsdirektivet (2006/95/EF).
Anvendt standard: EN 60204-1+A1: 2009.
- EMC-direktivet (2004/108/EF).
Anvendte standarder: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

GR Δήλωση Συμμόρφωσης

Εμείς, η Grundfos, δηλώνουμε με αποκλειστικά δική μας ευθύνη ότι τα προϊόντα DME στα οποία αναφέρεται η παρούσα δήλωση, συμμορφώνονται με τις εξής Οδηγίες του Συμβουλίου περί προσεγγίσις των νομοθεσιών των κρατών μελών της ΕΕ:

- Οδηγία για μηχανήματα (2006/42/ΕC).
Πρότυπα που χρησιμοποιήθηκαν: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Οδηγία χαμηλής τάσης (2006/95/ΕC).
Πρότυπο που χρησιμοποιήθηκε: EN 60204-1+A1: 2009.
- Οδηγία Ηλεκτρομαγνητικής Συμβατότητας (EMC) (2004/108/ΕC).
Πρότυπα που χρησιμοποιήθηκαν: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

FR Déclaration de Conformité

Nous, Grundfos, déclarons sous notre seule responsabilité, que les produits DME, auxquels se réfère cette déclaration, sont conformes aux Directives du Conseil concernant le rapprochement des législations des Etats membres CE relatives aux normes énoncées ci-dessous :

- Directive Machines (2006/42/CE).
Normes utilisées : EN 809 : 1998, EN ISO 12100-1+A1 : 2009, EN ISO 12100-2+A1 : 2009.
- Directive Basse Tension (2006/95/CE).
Norme utilisée : EN 60204-1+A1: 2009.
- Directive Compatibilité Electromagnétique CEM (2004/108/CE).
Normes utilisées : EN 61000-6-2: 2005, EN 61000-6-4: 2007.

NL Overeenkomstigheidverklaring

Wij, Grundfos, verklaren geheel onder eigen verantwoordelijkheid dat de producten DME waarop deze verklaring betrekking heeft, in overeenstemming zijn met de Richtlijnen van de Raad in zake de onderlinge aanpassing van de wetgeving van de EG Lidstaten betreffende:

- Machine Richtlijn (2006/42/EC).
Gebruikte normen: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Laagspannings Richtlijn (2006/95/EC).
Gebruikte norm: EN 60204-1+A1: 2009.
- EMC Richtlijn (2004/108/EC).
Gebruikte normen: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

FI Vaatimustenmukaisuusvakuutus

Me, Grundfos, vakuutamme omalla vastuullamme, että tuotteet DME, joita tämä vakuutus koskee, ovat EY:n jäsenvaltioiden lainsäädännön yhdenmukaistamiseen tähtäävien Euroopan neuvoston direktiivien vaatimusten mukaisia seuraavasti:

- Konedirektiivi (2006/42/EY).
Sovellettavat standardit: EN 809: 1998, EN ISO 12100-1+A1: 2009, EN ISO 12100-2+A1: 2009.
- Pienjännitedirektiivi (2006/95/EY).
Sovellettu standardi: EN 60204-1+A1: 2009.
- EMC-direktiivi (2004/108/EY).
Sovellettavat standardit: EN 61000-6-2: 2005, EN 61000-6-4: 2007.

Pfinztal, 15th July 2010



Ulrich Stemick
Technical Director
ALLDOS Eichler GmbH
Reetzstr. 85, D-76327 Pfinztal, Germany

Person authorised to compile technical file and empowered to sign the EC declaration of conformity.

DME

| | | |
|--|------------|------------|
| Installation and operating instructions | 4 | GB |
| Montage- und Betriebsanleitung | 30 | D |
| Notice d'installation et d'entretien | 57 | F |
| Istruzioni di installazione e funzionamento | 83 | I |
| Instrucciones de instalación y funcionamiento | 109 | E |
| Instruções de instalação e funcionamento | 135 | P |
| Οδηγίες εγκατάστασης και λειτουργίας | 161 | GR |
| Installatie- en bedieningsinstructies | 187 | NL |
| Monterings- och driftsinstruktion | 213 | S |
| Asennus- ja käyttöohjeet | 239 | FIN |
| Monterings- og driftsinstruktion | 265 | DK |

CONTENTS

GB

| | Page |
|---------------------------------------|-----------|
| 1. General description | 4 |
| 1.1 Applications | 4 |
| 1.2 Type key | 5 |
| 2. Technical data | 6 |
| 2.1 Mechanical data | 6 |
| 2.2 Electrical data | 6 |
| 2.3 Input/output data | 6 |
| 2.4 Dimensions | 7 |
| 3. Installation | 7 |
| 3.1 Safety instructions | 7 |
| 3.2 Installation environment | 7 |
| 3.3 Installation of pump | 7 |
| 3.4 Installation example | 8 |
| 3.5 Electrical connection | 8 |
| 3.6 Connection overview | 9 |
| 4. Functions | 10 |
| 4.1 Control panel | 10 |
| 4.2 Start/stop of pump | 11 |
| 4.3 Priming/venting of pump | 11 |
| 4.4 Level control | 11 |
| 4.5 Indicator lights and alarm output | 11 |
| 4.6 Fieldbus communication | 12 |
| 4.7 Menu | 13 |
| 4.8 Operating modes | 14 |
| 4.9 Manual | 14 |
| 4.10 Pulse | 14 |
| 4.11 Analog | 14 |
| 4.12 Timer | 16 |
| 4.13 Batch | 17 |
| 4.14 Anti-cavitation | 17 |
| 4.15 Capacity limitation | 18 |
| 4.16 Counters | 18 |
| 4.17 Resetting | 19 |
| 4.18 Return | 19 |
| 4.19 Language | 19 |
| 4.20 Input setup | 20 |
| 4.21 Measuring units | 21 |
| 4.22 Dosing monitoring | 22 |
| 4.23 Control panel lock | 23 |
| 5. Start-up | 24 |
| 6. Calibration | 25 |
| 6.1 Direct calibration | 26 |
| 6.2 Indirect calibration | 27 |
| 6.3 Check calibration | 28 |
| 7. Maintenance | 28 |
| 8. Service | 28 |
| 9. Fault finding chart | 29 |
| 10. Disposal | 29 |

1. General description

The Grundfos DME dosing pump is a self-priming diaphragm pump.

The pump consists of:

- a **cabinet** incorporating the drive unit and electronics,
- a **dosing head** with back plate, diaphragm, valves, connections and vent valve,
- a **control panel** incorporating display and buttons. The control panel can be fitted either to the end or to the side of the cabinet.

Being equipped with a stepper motor, this dosing pump is unique in its field. The stepper motor offers the possibility of varying the capacity by changing the duration of the dosing stroke.

Furthermore, the motor is controlled in such a way that the dosing gets as even and constant as possible, irrespective of the capacity range in which the pump is operating.

This is carried out as follows:

The speed of the suction stroke is kept constant and the stroke relatively short, irrespective of the capacity. Contrary to conventional pumps, which generate the dosing stroke as a short pulse, the duration of the dosing stroke will be as long as possible. Thus, an even dosing without peak values is ensured. As the pump is always dosing at full stroke length, it ensures the same high accuracy and suction capability, irrespective of the capacity, which is infinitely variable in the ratio of 1:1000.

The pump features an LCD display and a user-friendly control panel which gives access to the pump functions.

1.1 Applications

The DME dosing pump is designed for handling chemicals within the following ranges of applications, among others:

- Drinking water treatment.
- Wastewater treatment.
- Swimming pool water treatment.
- Boiler water treatment.
- Cooling water treatment.
- Process water treatment.
- Washing systems.



Before beginning installation procedures, these installation and operating instructions should be studied carefully. The installation and operation should also be in accordance with local regulations and accepted codes of good practice.

1.2 Type key

(Cannot be used for pump configuration.)

GB

Example: **DME 2-18 A-PP/E/C-F-3 1 1E F**

Pump range DME ..

Maximum pressure [bar]

Control variant Code

| | |
|------------------------|----|
| Standard | A |
| Standard + alarm relay | AR |
| Standard + Profibus | AP |
| Standard + GENibus | AG |

Dosing head material Code

| | |
|------------------------|----|
| Polypropylene | PP |
| PVDF | PV |
| Stainless steel 1.4401 | SS |

Gasket material Code

| | |
|------|---|
| EPDM | E |
| FKM | V |

Valve ball material Code

| | |
|------------------------|----|
| Ceramics | C |
| Stainless steel 1.4401 | SS |

Control panel Code

| | |
|--------------|---|
| Front-fitted | F |
| Side-fitted | S |

Voltage Code

| | |
|-------------------------|---|
| 1 x 100-240 V, 50-60 Hz | 3 |
|-------------------------|---|

Code Mains plug

| | |
|---|-------------|
| F | EU (Schuko) |
| B | USA, CAN |
| G | UK |
| I | AU |
| E | CH |
| J | JP |

Code Connection, suction/discharge

| | |
|---|--|
| 1 | Tubing 6/9 Tubing 4/6 supplied with the pump |
| 2 | Tubing 6/9 Tubing 6/12+9/12 supplied with the pump |
| 3 | Tubing 4/6 |
| 4 | Tubing 6/9 |
| 5 | Tubing 6/12 |
| 6 | Tubing 9/12 |
| A | Threaded Rp 1/4 |
| B | Threaded Rp 3/8 |
| E | Cementing d.10 |
| F | Cementing d.12 |

Code Valves

| | |
|---|---------------------|
| 1 | Standard valve |
| 2 | Spring-loaded valve |

2. Technical data

2.1 Mechanical data

| | DME 2 | DME 8 | DME 12 | DME 19 | DME 48 |
|--|---------|-------|--------|--------|--------|
| Maximum capacity without anti-cavitation *1 [l/h] | 2.5 | 7.5 | 12 | 18.5 | 48 |
| Maximum capacity with anti-cavitation *1 [l/h] | 1.8 | 5.6 | 9 | 14.5 | 37 |
| Maximum pressure [bar] | 18 | 10 | 6 | 6.2 | 2.6 |
| Maximum stroke rate per minute [stroke/min.] | 180 | 180 | 180 | 151 | 151 |
| Maximum suction lift during operation [m] | 6 | | | | |
| Maximum suction lift when priming with wet valves [m] | 1.8 | 3 | 3 | 3 | 3 |
| Maximum viscosity with spring-loaded valves *2 [mPas] | 500 | 500 | 500 | 500 | 100 |
| Maximum viscosity without spring-loaded valves *2 [mPas] | 200 | 200 | 200 | 200 | 100 |
| Diaphragm diameter [mm] | 28 | 38 | 42.5 | 55 | 77 |
| Liquid temperature [°C] | 0 to 50 | | | | |
| Ambient temperature [°C] | 0 to 45 | | | | |
| Accuracy of repeatability | ±1% | | | | |
| Sound pressure level [dB(A)] | <70 | | | | |

*1 Irrespective of counter pressure

*2 Maximum suction lift 1 metre

2.2 Electrical data

| | | DME 2, 8, 12 | DME 19, 48 |
|--|----------|-------------------------|------------|
| Supply voltage [VAC] | | 1 x 100-240 | |
| Maximum current consumption [A] | at 100 V | 0.30 | 0.36 |
| | at 230 V | 0.16 | 0.26 |
| Maximum power consumption P ₁ [W] | | 18 | 22 |
| Frequency [Hz] | | 50-60 | |
| Enclosure class | | IP 65 | |
| Insulation class | | B | |
| Supply cable | | 1.5 m H05RN-F with plug | |

2.3 Input/output data

The pump offers various input and output possibilities, depending on control variant.

| Signal input | |
|---|-----|
| Voltage in level sensor input [VDC] | 5 |
| Voltage in pulse input [VDC] | 5 |
| Minimum pulse-repetition period [ms] | 3.3 |
| Impedance in analog 4-20 mA input [Ω] | 250 |
| Maximum loop resistance in pulse signal circuit [Ω] | 350 |
| Maximum loop resistance in level signal circuit [Ω] | 350 |
| Signal output | |
| Maximum load of alarm relay output, at ohmic load [A] | 2 |
| Maximum voltage, alarm relay output [V] | 250 |

2.4 Dimensions

See dimensions at the end of these instructions.
All dimensions are in mm.

3. Installation

3.1 Safety instructions



- The liquid is under pressure and may be hazardous.
- When working with chemicals, local safety rules and regulations must be observed (e.g. wear protective clothes).
- Before starting work on the dosing pump and system, disconnect the electricity supply to the pump, ensuring that it cannot be accidentally switched on. Before reconnecting the electricity supply, make sure that the dosing hose is positioned in such a way that any chemical left in the dosing head is not ejected, thereby exposing persons to danger.
- If the vent valve in the dosing head is used, it must be connected to a hose which is led back to the tank.
- When changing a chemical, make sure that the materials of the dosing pump and system are resistant to the new chemical. If there is any risk of chemical reaction between the two types of chemicals, clean the pump and system thoroughly before adding the new chemical.
Proceed as follows:
Place the suction tube in water and press the  button until residual chemical has been removed.
Note: When the buttons  and  are pressed simultaneously, the pump can be set to run for a specific number of seconds at maximum capacity. The remaining number of seconds will appear in the display. The maximum value is 300 seconds.


3.2 Installation environment

- Exposure to direct sunlight should be avoided. This applies especially to pumps with plastic dosing heads, as this material can be damaged by sunlight.
- If the pump is installed outside, an enclosure or similar protection is required to protect the pump against rain and similar weathers.

3.3 Installation of pump

- See also the installation example in section 3.4.
- **Note:** The dosing head may contain water from the factory test. If a liquid which must not come into contact with water is to be dosed, it is recommended to let the pump run with another liquid to remove the water from the dosing head before installation.
- **Note:** Tighten the bolts in the dosing head after 2 to 5 operating hours (torque 5 Nm).
- Always install the pump on the supporting foot with vertical suction and discharge ports.
- Always use suitable tools for the mounting of plastic parts. Never apply unnecessary force.
- Make sure that the dosing pump and system are designed in such a way that neither system equipment nor buildings are damaged in case of leakage from the pump or rupture of hoses/pipes. The installation of leakage hoses and collecting tanks is recommended.
- Make sure that the drain hole in the dosing head points downwards, see fig. 1.
Note: It is important that the drain pipe/hole is not inserted direct into the tank contents, as gasses may penetrate into the pump.

Fig. 1

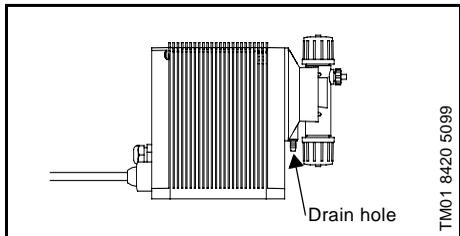


3.4 Installation example

The drawing in fig. 2 shows an installation example.

Fig. 2

GB

The DME pump can be installed in many different ways. The sketch below shows an example with side-fitted control panel. The tank is a Grundfos chemical tank with a Grundfos level control unit.

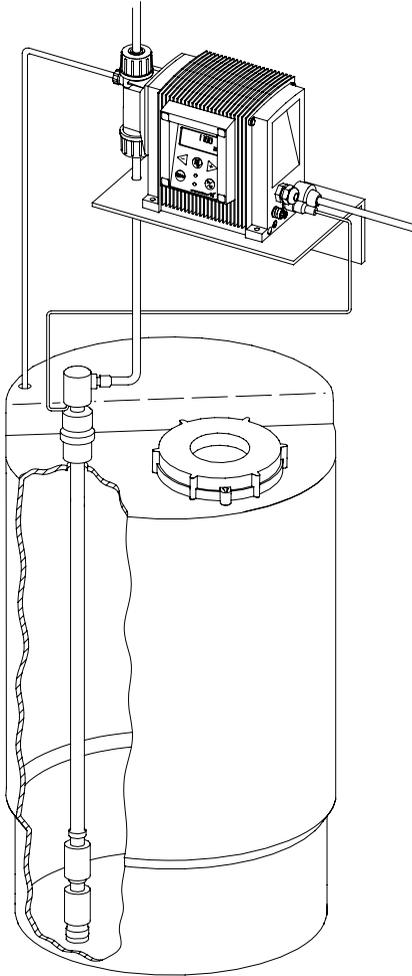


TM01 8421 0204

3.5 Electrical connection

- The electrical connection of the pump should be carried out by qualified persons in accordance with local regulations.
- For electrical data of the pump, see section 2.2.
- Do not lay signal cables, if any, together with power cables.

3.6 Connection overview

Fig. 3

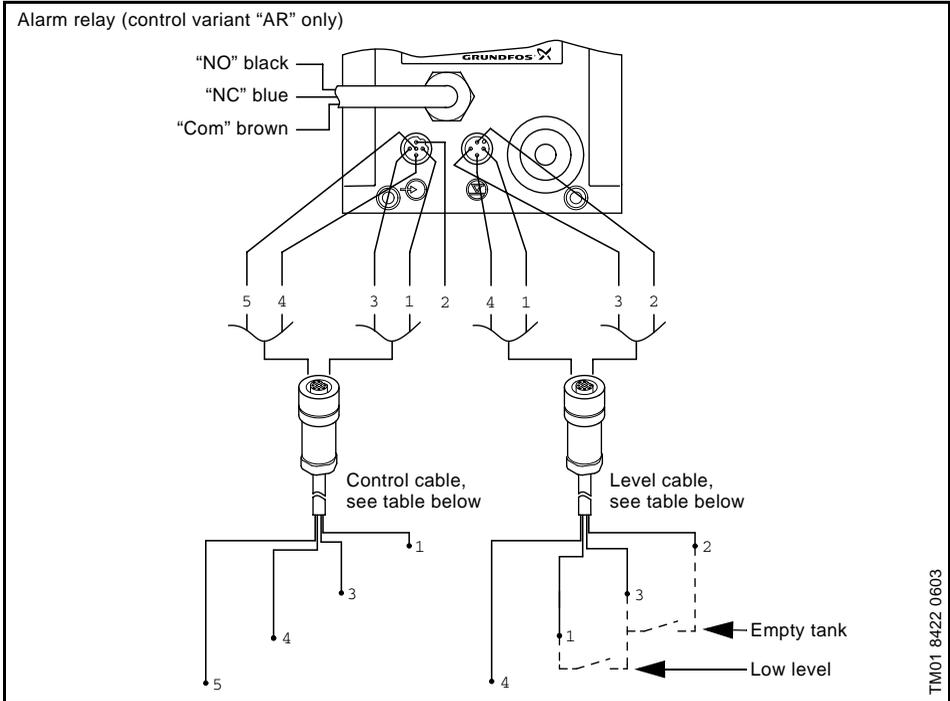

Control input:

| Number / colour | 1 / brown | 2 / white | 3 / blue | 4 / black | 5 / grey | Description |
|--------------------------|-----------|-----------|----------|-----------|----------|-------------|
| Function | | | | | | |
| Manual | 2 | | 2 | | | |
| Pulse | 1 | | 1 | | | |
| Pulse + external on/off | 1 | | 1 + 2 | | 2 | |
| Analog | | | | - | + | mA signal |
| Analog + external on/off | 2 | | 2 | - | + | mA signal |
| Timer + external on/off | 2 | | 2 | | | |
| Batch | 1 | | 1 | | | |

1 = Contact for pulse signal

2 = Contact for external on/off

Level input:


| Number / colour | 1 / brown | 2 / white | 3 / blue | 4 / black |
|-----------------|-----------|-------------------|------------------------|-----------|
| Function | Low level | | Low level | |
| | | Empty tank | Empty tank | |
| | Low level | Empty tank | Low level + empty tank | |
| | | Dosing monitoring | Dosing monitoring | |

4. Functions

4.1 Control panel

Fig. 4

GB

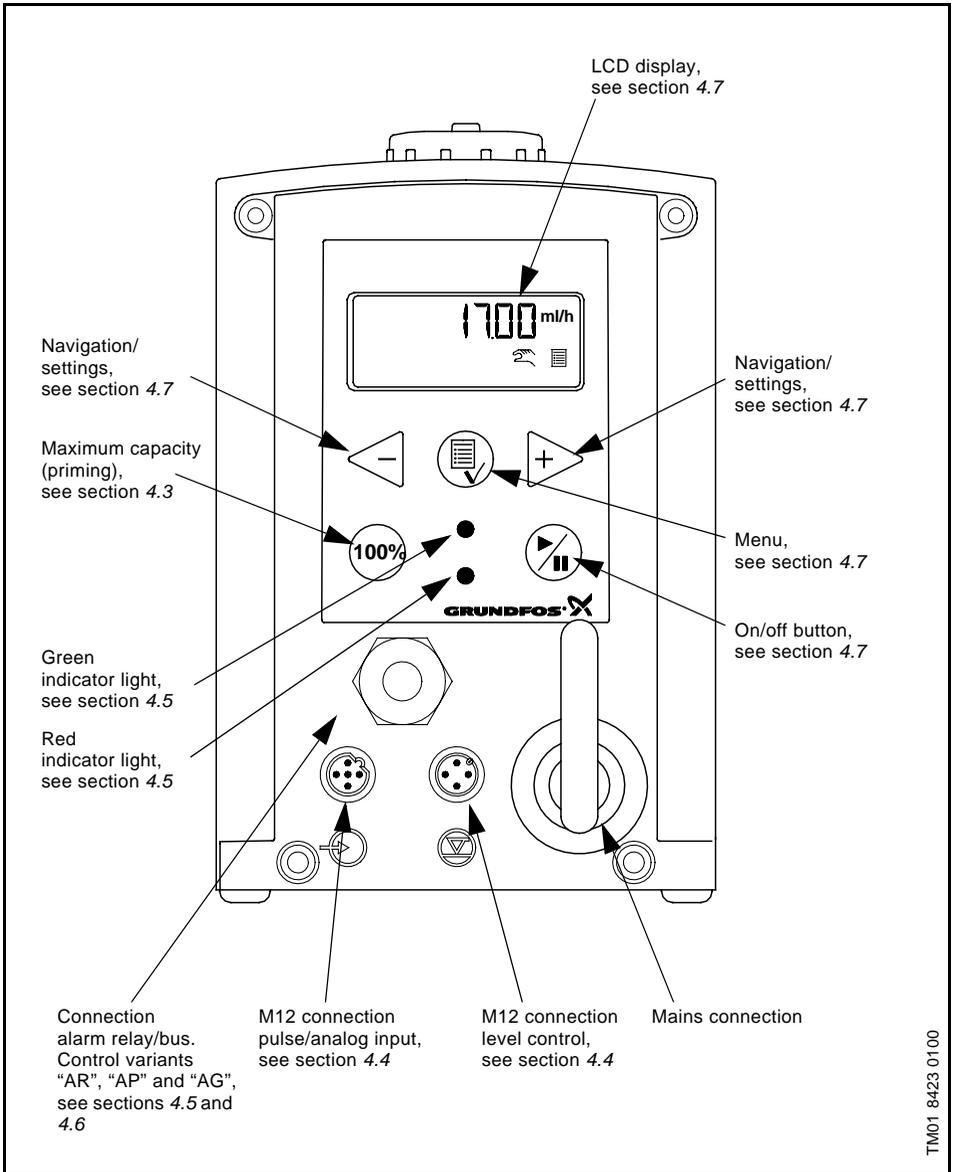

TM01 8423 0100

4.2 Start/stop of pump

The pump can be started/stopped in two different ways:

- Locally on the pump control panel.
- By means of an external on/off switch connected to the pulse input. See connection overview in section 3.6.

4.3 Priming/venting of pump

The pump control panel incorporates a  button. Press this button if the maximum pump capacity is required over a short period, e.g. during start-up. When the button is released, the pump automatically returns to the previous operating mode.

During priming/venting, it is recommended to let the pump run without a counter pressure or to loosen the vent valve by giving it a 1/8 to 1/4 turn.

Note: When the buttons  and  are pressed simultaneously, the pump can be set to run for a specific number of seconds at maximum capacity. The remaining number of seconds will appear in the display. The maximum value is 300 seconds.

4.4 Level control

The pump can be fitted with a level control unit for monitoring of the chemical level in the tank.

The pump can react to two level signals. The pump will react differently, depending on the influence on the individual level sensors.

| Level sensors | Pump reaction |
|---|---|
| Upper sensor activated (closed contact) | <ul style="list-style-type: none"> • Red indicator light is on. • Pump running. • Alarm relay activated.* |
| Lower sensor activated (closed contact) | <ul style="list-style-type: none"> • Red indicator light is on. • Pump stopped. • Alarm relay activated.* |

* Control variant "AR" only.

See section 3.6 for connection of the level control unit and alarm output.

4.5 Indicator lights and alarm output

The green and red indicator lights on the pump are used for operating and fault indication.

In control variant "AR", the pump can activate an external alarm signal by means of a built-in alarm relay. The alarm signal is activated by means of an internal potential-free contact.

The functions of the indicator lights and the built-in alarm relay appear from the table below:

| Condition | Green LED | Red LED | Dis-play | Alarm output* ¹ |
|---|-----------|---------|-------------------|----------------------------|
| Pump running | On | Off | Normal indication | |
| Set to stop | Flash-ing | Off | Normal indication | |
| Pump fault | Off | On | EEPROM | |
| Supply failure | Off | Off | Off | |
| Pump run-ning, low chemical level* ² | On | On | Normal indication | |
| Empty tank* ² | Off | On | Normal indication | |
| Analog signal < 2 mA | Off | On | Normal indication | |
| The dosed quantity is too small according to the signal from the dosing monitor* ³ | On | On | Normal indication | |
| Overheat-ing | Off | On | MAX. TEMP. | |

*¹ Control variant AR only.

*² Requires connection to level sensors.

*³ Requires activation of the dosing monitoring function and connection to a dosing monitor.

4.6 Fieldbus communication

The pump can be configured for fieldbus applications.

The following bus types are available:

| Control variant | Bus type |
|------------------------|-----------------|
| AP | Profibus |
| AG | GENIbus |


Separate instructions are supplied with each bus type.

4.7 Menu

The pump features a user-friendly menu which is activated by pressing the  button. During start-up, all texts will appear in English language. To select language, see section 4.19.

Fig. 5

All menu items are described in the following sections. When  appears at a menu item, it means that this item is activated. By selecting "RETURN" anywhere in the menu structure, you will return to the operating display without changes.

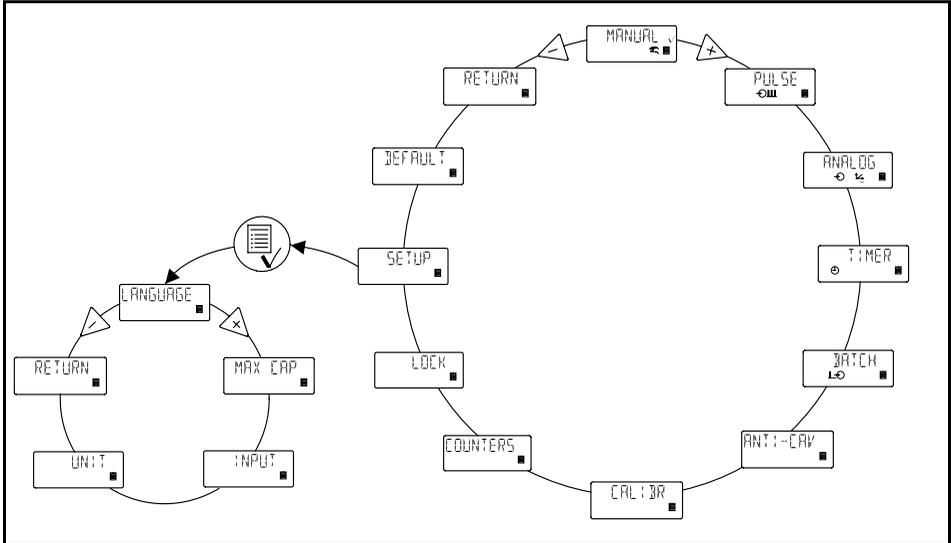

See section 4.9



See section 4.23



See section 4.10



See section 4.17



See section 4.11



See section 4.18



See section 4.12




See section 4.19



See section 4.13




See section 4.15



See section 4.14



See section 4.20



See section 6



See section 4.21



See section 4.16

4.8 Operating modes

Note: The displayed I and ml values are only reliable if the pump has been calibrated to the actual installation, see section 6.

The pump can run in five different operating modes:

- **Manual**
- **Pulse**
- **Analog**
- **Timer** (internal batch control)
- **Batch** (external batch control)

See description in the following sections.

4.9 Manual

The pump is dosing as constantly and evenly as possible, without any external signals.

Set the quantity to be dosed in l/h or ml/h. The pump automatically changes over between the measuring units.

Setting range:

DME 2: 2.5 ml/h - 2.5 (1.8*) l/h

DME 8: 7.5 ml/h - 7.5 (5.6*) l/h


DME 12: 12 ml/h - 12 (9*) l/h

DME 19: 18.5 ml/h - 18.5 (14.5*) l/h

DME 48: 48 ml/h - 48 (37*) l/h

* The figures in brackets indicate the maximum capacity when the anti-cavitation function is activated.

Fig. 6

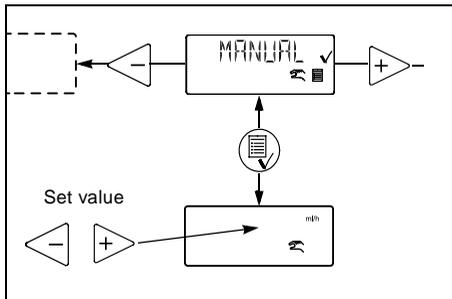

4.10 Pulse

The pump is dosing according to an external pulse signal, i.e. a water meter with pulse output or a controller.

Set the quantity to be dosed per pulse in ml/pulse. The pump adjusts its capacity according to two factors:

- Frequency of external pulses.
- The set quantity per pulse.

Setting range:

DME 2: 0.000018 ml/pulse - 5 ml/pulse


DME 8: 0.000069 ml/pulse - 15 ml/pulse

DME 12: 0.000111 ml/pulse - 24 ml/pulse

DME 19: 0.000204 ml/pulse - 37 ml/pulse

DME 48: 0.00530 ml/pulse - 96 ml/pulse

Fig. 7

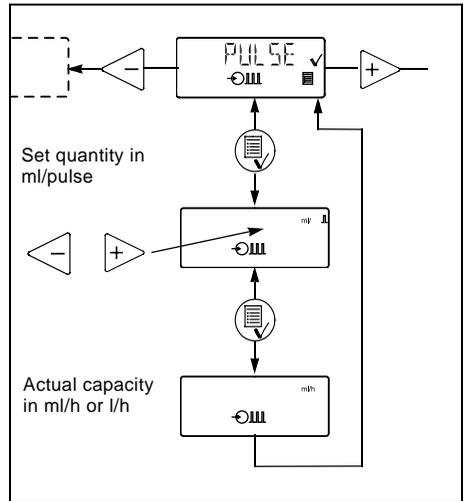

If the set quantity per pulse multiplied by the pulse frequency exceeds the pump capacity, the pump will run at maximum capacity. Excess pulses will be ignored and the "actual capacity" display will flash.

4.11 Analog

The pump is dosing according to an external analog signal. The dosed quantity is proportional to the input value in mA.

4-20 (default): 4 mA = 0%.

20 mA = 100%.

20-4: 4 mA = 100%.

20 mA = 0%.

0-20: 0 mA = 0%.

20 mA = 100%.

20-0: 0 mA = 100%.

20 mA = 0%.

See fig. 8.

The capacity limitation will influence the capacity. 100% corresponds to the maximum capacity of the pump or the set maximum capacity, see section 4.15.

Fig. 8


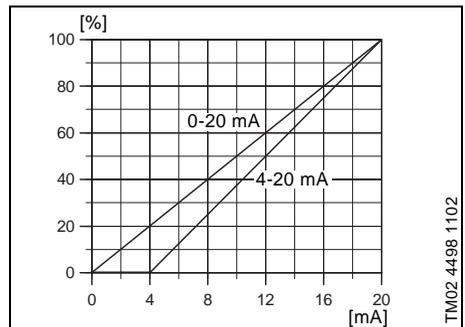



Fig. 9

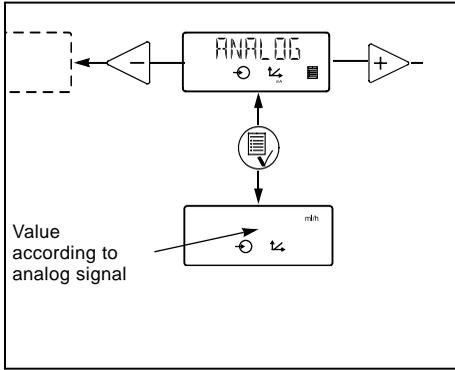

If 4-20 mA or 20-4 mA is selected and the signal falls below 2 mA, the pump will indicate a fault. This situation occurs if the connection is interrupted, for instance if the wire is damaged.

Change the analog mode as illustrated in fig. 10:

Fig. 10

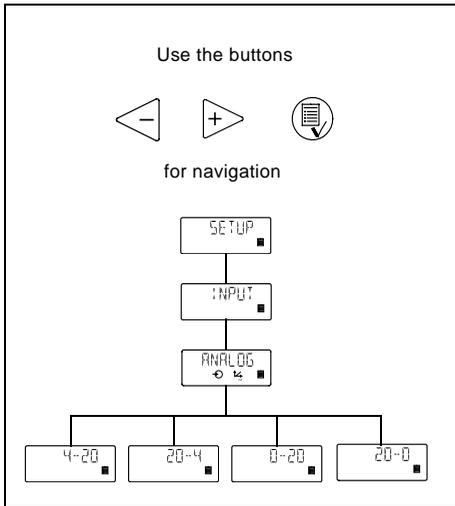

4.12 Timer

The pump is dosing the set quantity in batches at the maximum capacity or the set maximum capacity, see section 4.15.


The time until the first dosing "NX" and the following sequences "IN" can be set in minutes, hours and days. The maximum time limit is 9 days, 23 hours and 59 minutes (9:23:59). The lowest acceptable value is 1 minute. The internal timer continues even if the pump is stopped by means of the on/off button, empty tank or stop signal, see fig. 11.

During operation, "NX" will always count down from "IN" to zero. In this way, the remaining time until the next batch can always be read.

"IN" must be higher than the time required to perform one batch. If "IN" is lower, the next batch will be ignored.

In case of supply failure, the set quantity to be dosed, the "IN" time and the remaining "NX" time are stored. When the supply is reconnected, the pump will start up with the "NX" time at the time of the supply failure. In this way, the timer cycle will continue, but it has been delayed by the duration of the supply failure.

Fig. 11

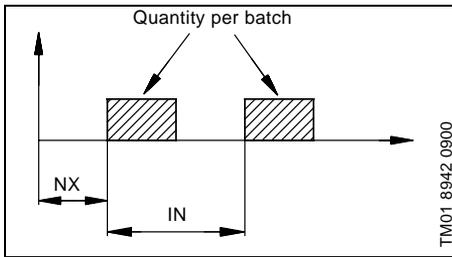

Setting range:

- DME 2: 0.23 ml/batch - 5 l/batch
- DME 8: 0.69 ml/batch - 15 l/batch
- DME 12: 1.11 ml/batch - 24 l/batch
- DME 19: 2.04 ml/batch - 37 l/batch
- DME 48: 5.3 ml/batch - 96 l/batch


Only values corresponding to complete dosing strokes (according to the calibration factor) can be selected.

Example: If the calibration factor is 23.3 (= 0.233 ml/stroke), the minimum settable value in timer or batch mode will be 0.233 ml -> the next will be 0.466 ml -> the next will be 0.699 ml, etc.

These steps will continue up to a value corresponding to 100 dosing strokes. Above this value, the setting range has standard steps as in other operating modes.

If the calibration factor is changed after setting of timer or batch mode, the pump will automatically recalculate a new amount of dosing strokes per batch and change the display value to the nearest possible value compared to the first one set.

Fig. 12

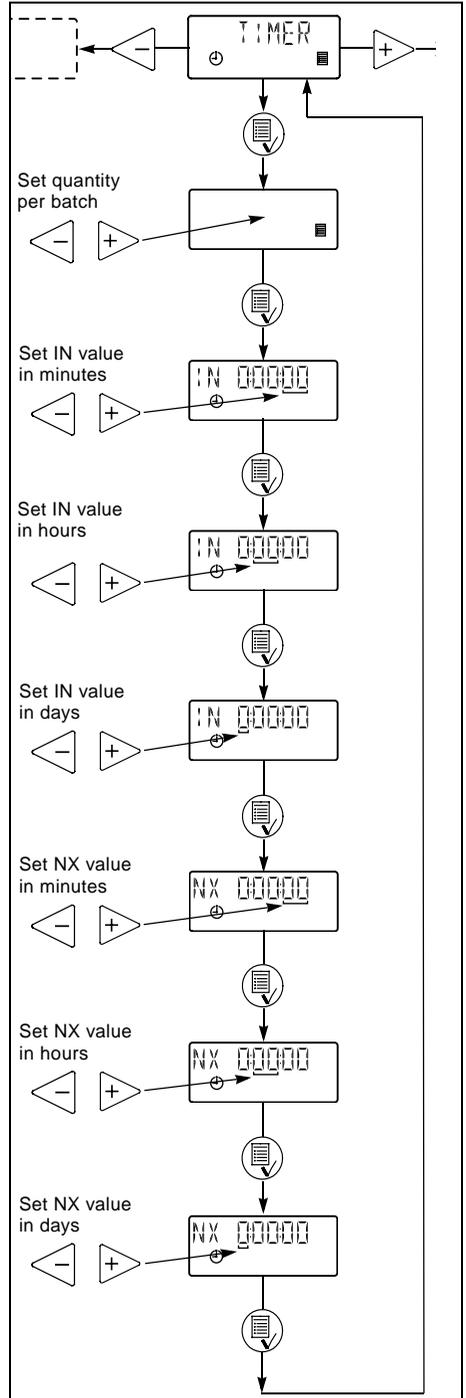


4.13 Batch

The pump is dosing the set quantity in batches at the maximum capacity or the set maximum capacity, see section 4.15.

The quantity is dosed every time the pump receives an external pulse.


If the pump receives new pulses before the previous batch is performed, these pulses will be ignored.

Fig. 13

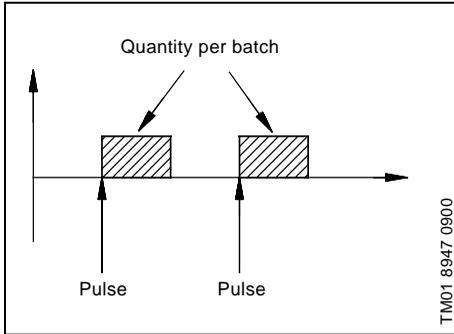

The setting range is the same as for Timer, see section 4.12.

Fig. 14

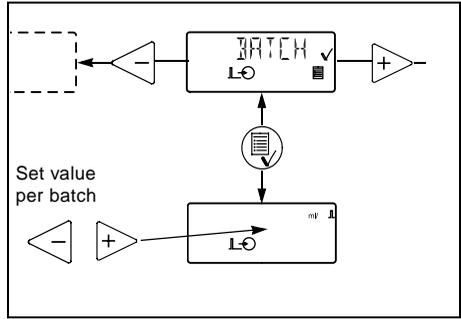

4.14 Anti-cavitation


The pump features an anti-cavitation function. When this function is selected, the pump extends and smooths its suction stroke, resulting in softer priming.

The anti-cavitation function is used:

- when pumping liquids of high viscosity,
- in the case of a long suction tube and
- in the case of a high suction lift.

The maximum pump capacity is reduced when this function is selected. See section 2.1 *Mechanical data*.

Fig. 15

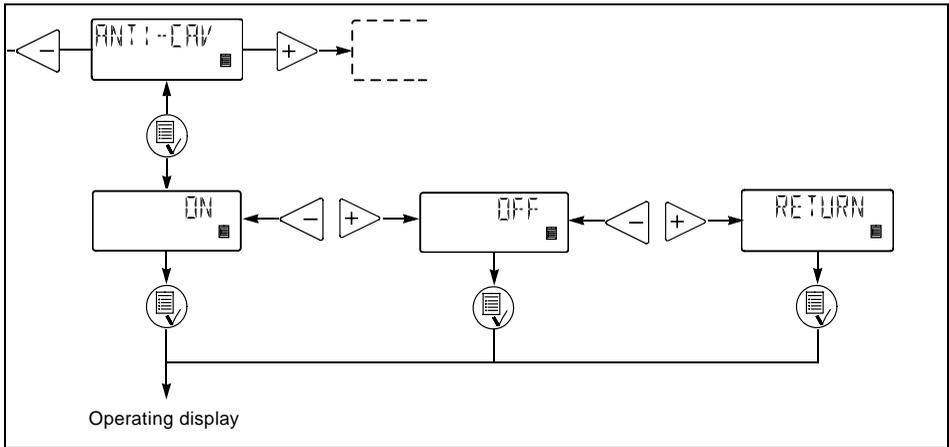


4.15 Capacity limitation

This function offers the possibility of reducing the maximum pump capacity (MAX CAP). It influences the functions in which the pump is normally operating at maximum capacity.

Under normal operating conditions, the pump cannot operate at a capacity which is higher than the one stated in the display. This does not apply to the maximum capacity button , see section 4.3.

Fig. 16

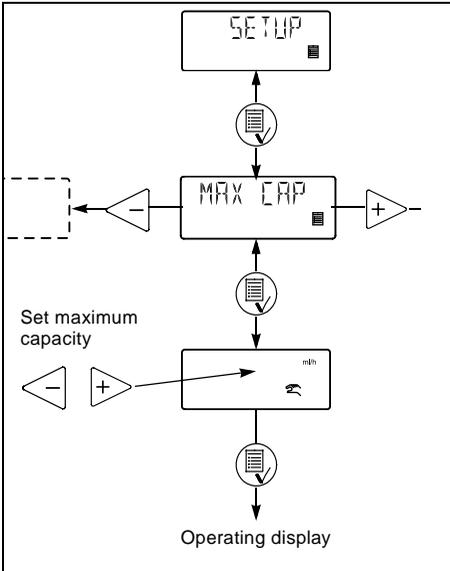


4.16 Counters

The pump can display “non-resettable” counters for:

- **“QUANTITY”**
Accumulated value of dosed quantity in litres or US gallons.
- **“STROKES”**
Accumulated number of dosing strokes.
- **“HOURS”**
Accumulated number of operating hours.
- **“POWER ON”**
Accumulated number of times the electricity supply has been switched on.


Fig. 17

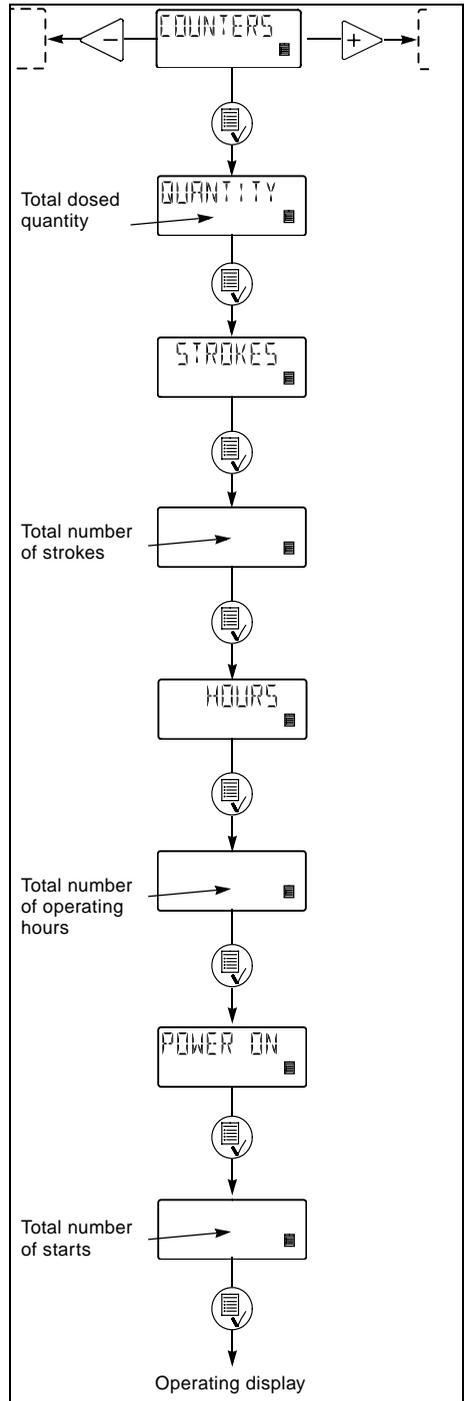

4.17 Resetting

When "DEFAULT" is activated, the pump will return to the factory settings.

Fig. 18

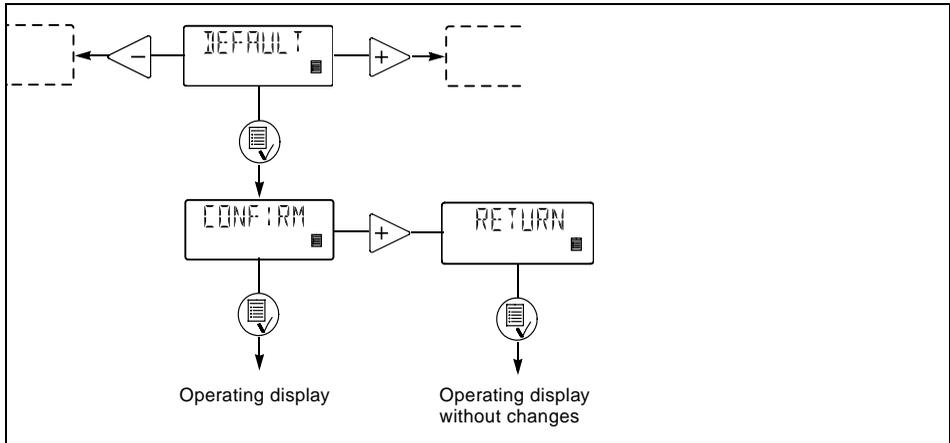

GB

4.18 Return

Fig. 19




The "RETURN" function makes it possible to return from any level in the menu to the operating display without changes after the menu functions have been used.

4.19 Language

The display text can be displayed in one of the following languages:

- English
- German
- French
- Italian
- Spanish
- Portuguese
- Dutch
- Swedish
- Finnish
- Danish
- Czech
- Slovak
- Polish
- Russian

Fig. 20

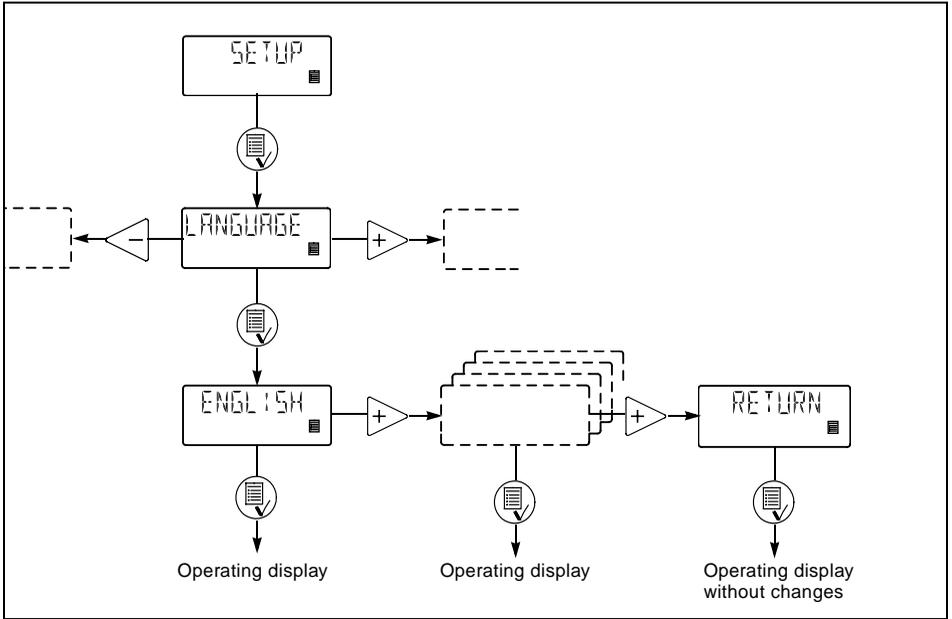

4.20 Input setup

Fig. 21 shows all possible settings.

The level and stop inputs can be changed from NO (normally open) to NC (normally closed) function. If changed, the inputs must be short-circuited in normal operation.


For the analog input, one of the following signal types can be selected:

- 4-20 mA (default),
- 20-4 mA,
- 0-20 mA,
- 20-0 mA.

See also section 4.11 Analog.

Change the level input to an input for dosing monitoring as illustrated in fig. 21.

Fig. 21

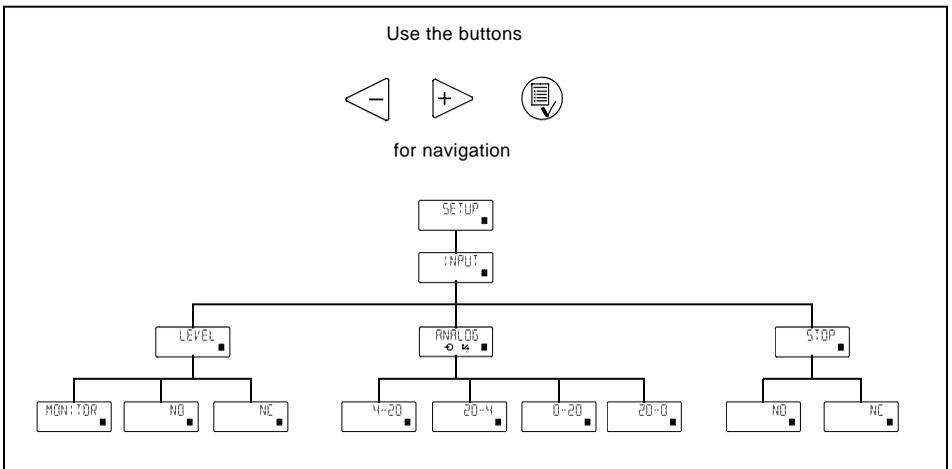

4.21 Measuring units

It is possible to select metric units (litre/millilitre) or US units (gallons/millilitre).

Metric measuring units:


- In **manual and analog modes**, set the quantity to be dosed in litres per hour (l/h) or millilitres per hour (ml/h).
- In **pulse mode**, set the quantity to be dosed in ml/pulse. The actual capacity is indicated in litres per hour (l/h) or millilitres per hour (ml/h).
- For **calibration**, set the quantity to be dosed in ml per 100 strokes.
- In **timer and batch modes**, set the quantity to be dosed in litres (l) or millilitres (ml).
- Under the "QUANTITY" menu item in the "COUNTERS" menu, the dosed quantity is indicated in litres.

US measuring units:

- In **manual and analog modes**, set the quantity to be dosed in gallons per hour (gph).
- In **pulse mode**, set the quantity to be dosed in ml/pulse. The actual capacity is indicated in gallons per hour (gph).
- For **calibration**, set the quantity to be dosed in ml per 100 strokes.
- In **timer and batch modes**, set the quantity to be dosed in gallons (gal).
- Under the "QUANTITY" menu item in the "COUNTERS" menu, the dosed quantity is indicated in US gallons (gal).

GB


Fig. 22

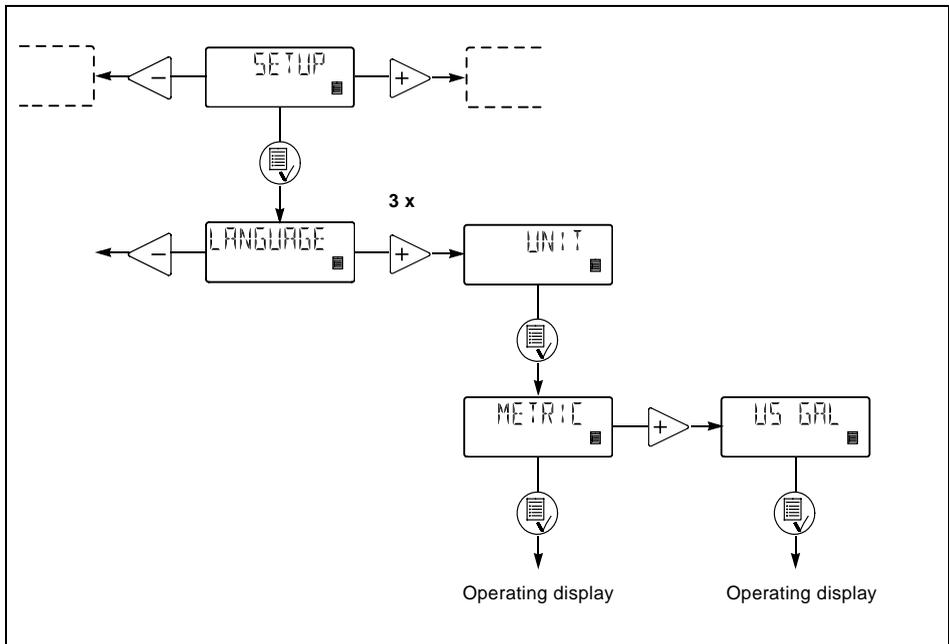

4.22 Dosing monitoring

A dosing monitor is available as an accessory. Separate instructions are supplied with the monitor.

Fig. 23

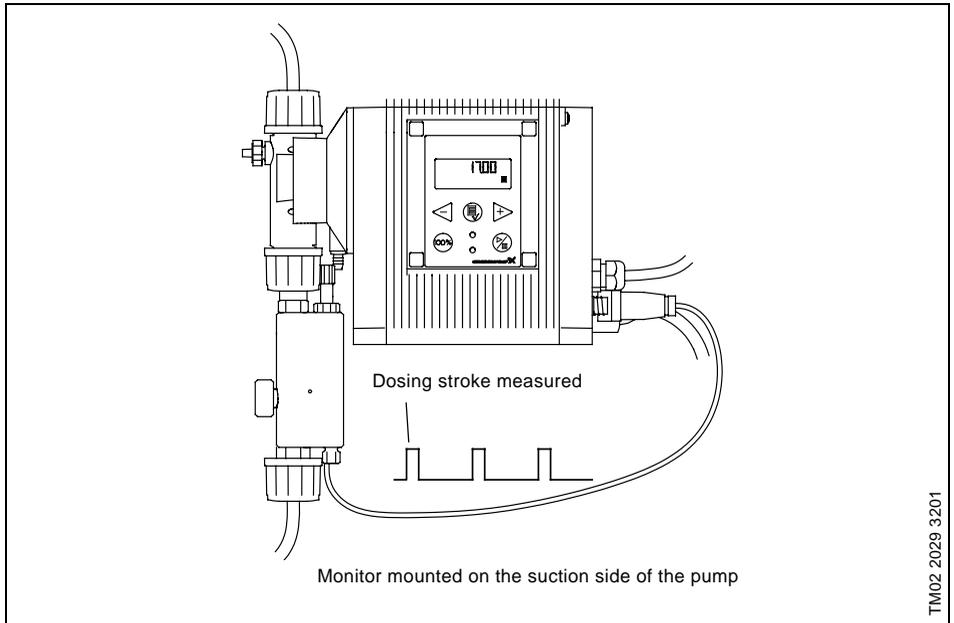

The dosing monitor is designed to monitor the dosing of liquids which may cause gas accumulation in the dosing head, thus stopping the dosing process even if the pump is still operating.

For every measured dosing stroke, the dosing monitor gives a pulse signal to the level input so that the pump can compare performed dosing strokes (from internal stroke sensor) with externally measured physical strokes (from the dosing monitor). If an external dosing stroke is not measured together with the internal dosing stroke, this is considered a fault that may have been provoked by empty tank or gas in the dosing head.

4.23 Control panel lock

It is possible to lock the buttons on the control panel to prevent malfunction of the pump. The locking function can be set to "ON" or "OFF". The default setting is "OFF".

A PIN code must be entered to change from "OFF" to "ON". When "ON" is selected for the first time, "_____" will appear in the display. If a code has already been entered, it will appear when an attempt to change to "ON" is made. This code can either be re-entered or changed.

If no code has been entered, a code must be set in the same way as the "NX" and "IN" values described in section 4.12.

If a code has already been entered, active digits are flashing.

If attempts are made to operate the pump in locked condition, "LOCKED" will appear in the display for 2 seconds, followed by "_____" . A code must be entered. If the entering of a code has not been started within 10 seconds, the operating display without changes will appear.

If a wrong code is entered, "LOCKED" will appear in the display for 2 seconds, followed by "_____" . A new code must be entered. If the entering of a code has not been started within 10 seconds, the operating display without changes will appear. This display will also appear if the entering of the correct code exceeds 2 minutes.

If the locking function has been activated but the control panel is unlocked, the control panel will be locked automatically if it is not operated for 2 minutes.


The locking function can also be reactivated by selecting "ON" in the "LOCK" menu. The previously entered code will then appear and must be re-entered by pressing the  button four times. The code can also be changed.

The control panel can be unlocked either by means of the selected code or the factory code 2583.

The following buttons and inputs are still active when the panel is locked:

- Priming (-button).
- On/off button.
- All external inputs.

Fig. 24

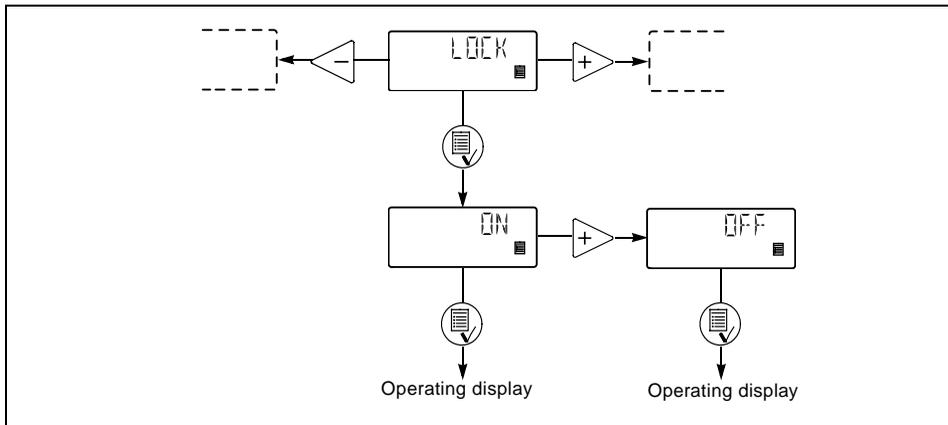

Activating the locking function and locking the control panel:

1. Select "LOCK" in the menu.
2. Select "ON" by means of the buttons  and  and confirm with .
3. Enter or re-enter a code by means of the buttons ,  and .

The locking function has now been activated and the control panel is locked.

Unlocking the control panel (without deactivating the locking function):

1. Press  once. "LOCKED" appears in the display for 2 seconds, followed by "_____" .
2. Enter the code by means of the buttons ,  and .

The control panel has now been unlocked and will automatically be locked again if the control panel is not operated for 2 minutes.

Deactivating the locking function:







1. Unlock the control panel as described above.
2. Select "LOCK" in the menu.
3. Select "OFF" by means of the buttons  and  and confirm with .

The locking function has now been deactivated and the control panel is unlocked.

* The panel can always be unlocked with code 2583.

5. Start-up

GB

| Step | Action |
|------|--|
| 1 |  <p>Connect the hoses/pipes:</p> <ul style="list-style-type: none">• Connect the suction and dosing tubes/pipes to the pump.• Connect a tube to the vent valve, if required, and lead the hose to the tank. |
| 2 |  <p>Switch on the electricity supply:</p> <ul style="list-style-type: none">• The display is on.• The green indicator light is flashing (the pump has stopped).• Select language, if required, see section 4.19. |
| 3 |  <p>Select the operating mode (see section 4.8):</p> <ul style="list-style-type: none">• Manual.• Pulse.• Analog.• Timer.• Batch. |
| 4 |  <p>Connect the cables:</p> <ul style="list-style-type: none">• Connect the control/level cables, if any, to the pump, see section 3.6. |
| 5 |  <p>Start the pump:</p> <ul style="list-style-type: none">• Start the pump by pressing the on/off button.• The green indicator light is permanently on. |
| 6 |  <p>Priming/venting:</p> <ul style="list-style-type: none">• Press the 100% button on the pump control panel and let the pump run without a counter pressure. Loosen the vent valve by giving it a 1/8 to 1/4 turn, if required.• When the buttons 100% and → are pressed simultaneously during priming, the pump can be set to run for a specific number of seconds at maximum capacity. |
| 7 |  <p>Calibration:</p> <ul style="list-style-type: none">• When the pump has been primed and is running at the right counter pressure, calibrate the pump, see section 6. |

If the pump is not operating satisfactorily, see section 9. *Fault finding chart.*

6. Calibration

It is important that the pump is calibrated after installation to ensure that the correct value (ml/h or l/h) appears in the display.

The calibration can be carried out in three different ways:

- **Direct calibration** (recommended).
The dosed quantity of 100 strokes is measured directly. See section 6.1.
- **Indirect calibration.**
A calibration factor selected from a table is used for the specific installation. This method can be used if it is not possible to carry out a direct calibration. Indirect calibration will never be as accurate as direct calibration. See section 6.2.
- **Check calibration.** See section 6.3.








6.1 Direct calibration

Before calibration, make sure:

- that the pump is installed with foot valve, injection valve, etc. in the existing system.
- that the pump is running at the counter pressure it is supposed to operate at (adjust the counter pressure valve, if required).

- that the pump is operating with the correct suction lift.

To carry out a direct calibration, proceed as follows:
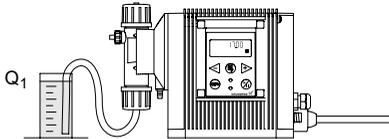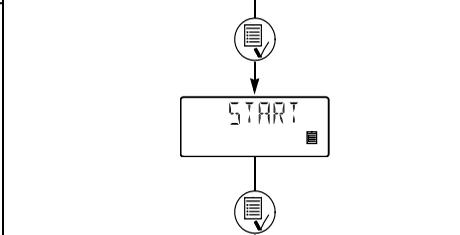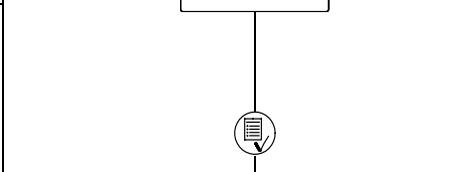
| Action | Pump display |
|---|--|
| 1. Prime the dosing head and the suction tubing. | |
| 2. Stop the pump. The green LED is flashing. | |
| 3. Fill a graduated glass with dosing liquid, Q_1 . DME 2: approx. 40 ml DME 19: approx. 500 ml DME 8: approx. 150 ml DME 48: approx. 1000 ml DME 12: approx. 250 ml | |
| 4. Read and note the quantity Q_1 . | |
| 5. Place the suction tubing in the graduated glass.  | |
| 6. Go to the calibration menu, see section 4.7. |  |
| 7. Press the  button twice. |  |
| 8. The pump is performing 100 dosing strokes. | |
| 9. The factory-calibration value appears in the display. |  |
| 10. Remove the suction tubing from the graduated glass and read Q_2 .  |  |
| 11. Set the display value to $Q_d = Q_1 - Q_2$. |  |
| 12. Confirm with the  button. |  |
| 13. The pump is now calibrated and returns to the operating display. |  |

6.3 Check calibration

In check calibration, the calibration value is calculated by reading the consumption of chemical in a specific period and comparing this with the number of dosing strokes performed in the same period.

This calibration method is very accurate and especially suitable for check calibration after long periods of operation or if direct calibration is impossible. The calibration can for instance be carried out when the chemical tank is replaced or filled.

To carry out a check calibration, proceed as follows:

1. Stop the pump by pressing the  button.
2. Read the counter and note the number of dosing strokes, see section 4.16.
3. Read and note the quantity in the chemical tank.
4. Start the pump by pressing the  button and let it run for at least 1 hour. The longer the pump is operating, the more accurate the calibration will be.
5. Stop the pump by pressing the  button.
6. Read the counter and note the number of dosing strokes, see section 4.16.
7. Read and note the quantity in the chemical tank.
8. Calculate the dosed quantity in ml and the number of dosing strokes performed during the operating period.
9. Calculate the calibration value as follows:
(dosed quantity in ml/dosing strokes) x 100.
10. Set the calculated value in the calibration menu like for indirect calibration, see section 6.2.

7. Maintenance

The pump is maintenance-free. However, it is recommended to keep the pump clean.

The dosing pump is produced according to the highest quality standards and has long life. The pump incorporates wear parts such as diaphragm, valve seat and valve balls.

To ensure long life and to reduce the risk of disturbance of operation, visual checks should be carried out regularly.

It is possible to order dosing heads, valves and diaphragms in materials which are suitable for the specific liquid to be pumped. See the product numbers at the end of these instructions.

8. Service

Before returning the pump to Grundfos for service, the safety declaration at the end of these instructions must be filled in by authorized personnel and attached to the pump in a visible position.

Note: If a pump has been used for a liquid which is injurious to health or toxic, the pump will be classified as contaminated.

If Grundfos is requested to service the pump, it must be ensured that the pump is free from substances that can be injurious to health or toxic. If the pump has been used for such substances, the pump must be cleaned before it is returned.

If proper cleaning is not possible, all relevant information about the chemical must be provided.

If the above is not fulfilled, Grundfos can refuse to accept the pump for service. Possible costs of returning the pump are paid by the customer.

The safety declaration can be found at the end of these instructions (only in English).

Note: The replacement of the supply cable must be carried out by an authorised Grundfos service workshop.

9. Fault finding chart

| Fault | Cause | Remedy |
|--|--|--|
| The dosing has stopped or the output is too low. | Valves leaking or blocked. | Check and clean valves. |
| | Valves incorrectly installed. | Remove and fit valves. Check that the arrow on the valve casing is pointing in the liquid flow direction. Check that all O-rings have been fitted correctly. |
| | Suction valve or suction pipe/hose leaking or blocked. | Clean and seal the suction pipe/hose. |
| | Suction lift too high. | Install the pump in a lower position. Install a priming tank. |
| | Viscosity too high. | Select the anti-cavitation function, see section 4.14. |
| | | Install a pipe/hose with larger cross-section. |
| Fit spring-loaded valves. | | |
| Pump out of calibration. | Calibrate the pump, see section 6. | |
| Pump dosing too little or too much. | Pump out of calibration. | Calibrate the pump, see section 6. |
| Pump dosing irregularly. | Valves leaking or blocked. | Check and clean the valves. |
| Leakage from drain hole. | Diaphragm defective. | Install a new diaphragm. |
| Frequent diaphragm failures. | Diaphragm not fastened properly. | Install a new diaphragm and ensure that the diaphragm is fastened properly. |
| | Counter-pressure too high (measured at the pump discharge port). | Check the system. Check the injection valve, if required. Reduce the dosing stroke by fitting a pulsation dampener. |
| | Sediment in dosing head. | Clean/flush the dosing head. |


10. Disposal

Disposal of this product or parts of it must be carried out according to the following guidelines:

1. Use the local public or private waste collection service.
2. In case such waste collection service does not exist or cannot handle the materials used in the product, please deliver the product or any hazardous materials from it to your nearest Grundfos company or service workshop.


Service kits, DME

| Pump size | Valves | Materials dosing head/ gaskets/ valve balls | Product numbers | | | | |
|---------------|---------------|---|---|--------------------------------------|------------------|-------------------|----------|
| | | | Complete dosing head Pos. 2+3x3+2x9+13+14+15+18 | Valves + diaphragm Pos. 2+3 x pos. 3 | Diaphragm Pos. 2 | Valves 3 x pos. 3 | |
| DME 2 | Standard | PP/EPDM/Ceramics | 96440665 | 96441131 | 96440740 | 96440705 | |
| | | PP/FKM/Ceramics | 96446814 | 96446774 | 96440740 | 96446834 | |
| | | PVDF/FKM/Ceramics | 96440667 | 96441133 | 96440740 | 96440707 | |
| | | Stainless steel/FKM/Stainless steel | 96440669 | 96441135 | 96440740 | 96440709 | |
| | Spring-loaded | PP/EPDM/Ceramics | 96440666 | 96441132 | 96440740 | 96440706 | |
| | | PP/FKM/Ceramics | 96446815 | 96446775 | 96440740 | 96446835 | |
| | | PVDF/FKM/Ceramics | 96440668 | 96441134 | 96440740 | 96440708 | |
| | | Stainless steel/FKM/Stainless steel | 96440670 | 96441136 | 96440740 | 96440710 | |
| DME 8 | Standard | PP/EPDM/Ceramics | 96440671 | 96441149 | 96440743 | 96440705 | |
| | | PP/FKM/Ceramics | 96446816 | 96446780 | 96440743 | 96446834 | |
| | | PVDF/FKM/Ceramics | 96440673 | 96441151 | 96440743 | 96440707 | |
| | | Stainless steel/FKM/Stainless steel | 96440675 | 96441153 | 96440743 | 96440709 | |
| | Spring-loaded | PP/EPDM/Ceramics | 96440672 | 96441150 | 96440743 | 96440706 | |
| | | PP/FKM/Ceramics | 96446817 | 96446781 | 96440743 | 96446835 | |
| | | PVDF/FKM/Ceramics | 96440674 | 96441152 | 96440743 | 96440708 | |
| | | Stainless steel/FKM/Stainless steel | 96440676 | 96441154 | 96440743 | 96440710 | |
| | DME 12 | Standard | PP/EPDM/Ceramics | 96440659 | 96441125 | 96440739 | 96440705 |
| | | | PP/FKM/Ceramics | 96446812 | 96446772 | 96440739 | 96446834 |
| | | | PVDF/FKM/Ceramics | 96440661 | 96441127 | 96440739 | 96440707 |
| | | | Stainless steel/FKM/Stainless steel | 96440663 | 96441129 | 96440739 | 96440709 |
| Spring-loaded | | PP/EPDM/Ceramics | 96440660 | 96441126 | 96440739 | 96440706 | |
| | | PP/FKM/Ceramics | 96446813 | 96446773 | 96440739 | 96446835 | |
| | | PVDF/FKM/Ceramics | 96440662 | 96441128 | 96440739 | 96440708 | |
| | | Stainless steel/FKM/Stainless steel | 96440664 | 96441130 | 96440739 | 96440710 | |
| DME 19 | Standard | PP/EPDM/Ceramics | 96440647 | 96441137 | 96440741 | 96440711 | |
| | | PP/FKM/Ceramics | 96446808 | 96446776 | 96440741 | 96446836 | |
| | | PVDF/FKM/Ceramics | 96440649 | 96441139 | 96440741 | 96440713 | |
| | | Stainless steel/FKM/Stainless steel | 96440651 | 96441141 | 96440741 | 96440723 | |
| | Spring-loaded | PP/EPDM/Ceramics | 96440648 | 96441138 | 96440741 | 96440712 | |
| | | PP/FKM/Ceramics | 96446809 | 96446777 | 96440741 | 96446837 | |
| | | PVDF/FKM/Ceramics | 96440650 | 96441140 | 96440741 | 96440722 | |
| | | Stainless steel/FKM/Stainless steel | 96440652 | 96441142 | 96440741 | 96440724 | |
| DME 48 | Standard | PP/EPDM/Ceramics | 96440653 | 96441143 | 96440742 | 96440711 | |
| | | PP/FKM/Ceramics | 96446810 | 96446778 | 96440742 | 96446836 | |
| | | PVDF/FKM/Ceramics | 96440655 | 96441145 | 96440742 | 96440713 | |
| | | Stainless steel/FKM/Stainless steel | 96440657 | 96441147 | 96440742 | 96440723 | |
| | Spring-loaded | PP/EPDM/Ceramics | 96440654 | 96441144 | 96440742 | 96440712 | |
| | | PP/FKM/Ceramics | 96446811 | 96446779 | 96440742 | 96446837 | |
| | | PVDF/FKM/Ceramics | 96440656 | 96441146 | 96440742 | 96440722 | |
| | | Stainless steel/FKM/Stainless steel | 96440658 | 96441148 | 96440742 | 96440724 | |

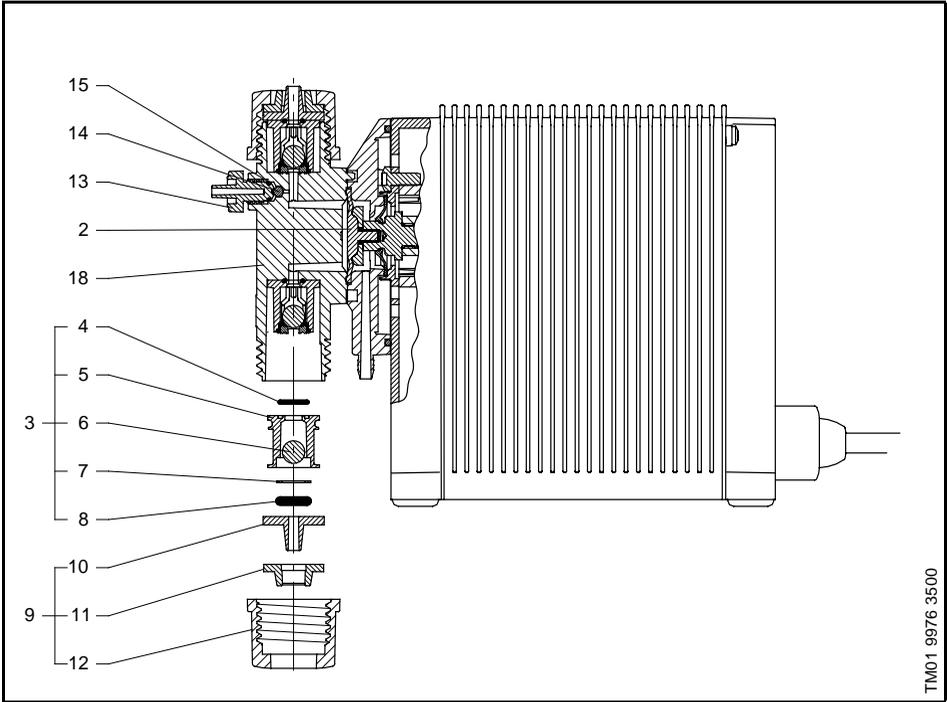

TM01 9976 3500

Dimensions

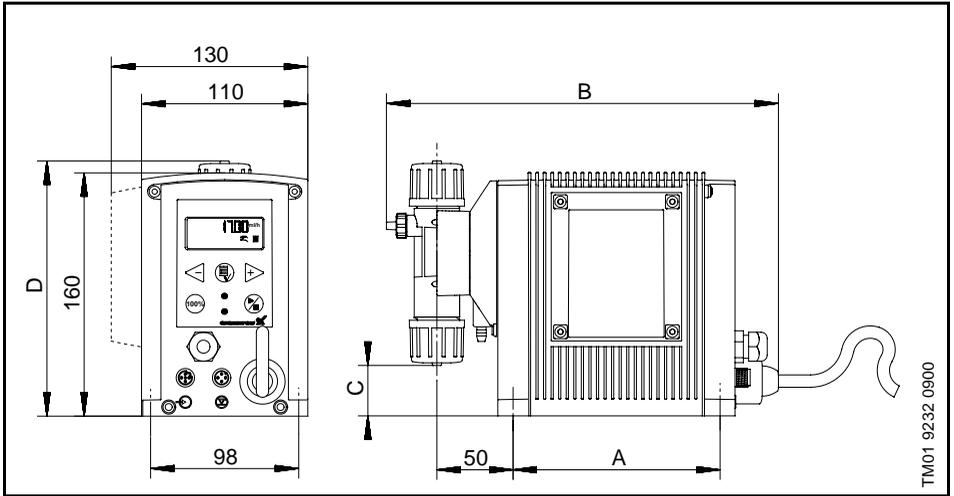

| | DME 2, DME 8, DME 12 | DME 19, DME 48 |
|-----------------|-----------------------------|-----------------------|
| A = [mm] | 137 | 192 |
| B = [mm] | 239 | 294 |
| C = [mm] | 36 | 15 |
| D = [mm] | 168 | 188 |

Safety declaration

Please copy, fill in and sign this sheet and attach it to the pump returned for service.

We hereby declare that this product:

Product type: _____

Model number: _____

No liquid or water: _____

Chemical, name: _____


(see pump nameplate)

is free from hazardous chemicals, biological and radioactive substances.

Fault description

Please make a circle around the damaged part.

In the case of an electrical or functional fault, please mark the cabinet.

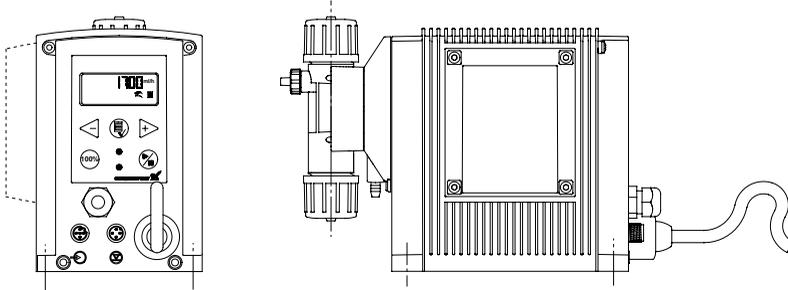

TM02 8952 1104

Please give a short description of the fault:

Date and signature

Company stamp

Argentina

Bombas GRUNDFOS de Argentina S.A.
Ruta Panamericana km. 37.500 Lote 34A
1619 - Garin
Pcia. de Buenos Aires
Phone: +54-3327 414 444
Telefax: +54-3327 411 111

Australia

GRUNDFOS Pumps Pty. Ltd.
P.O. Box 2040
Regency Park
South Australia 5942
Phone: +61-8-8461-4611
Telefax: +61-8-8340 0155

Austria

GRUNDFOS Pumpen Vertrieb Ges.m.b.H.
Grundfosstraße 2
A-5082 Grödig/Salzburg
Tel.: +43-6248-883-0
Telefax: +43-6246-883-30

Belgium

N.V. GRUNDFOS Bellux S.A.
Boomsstambweg 81-83
B-2630 Aartselaar
Tél.: +32-3-870 7300
Téléphone: +32-3-870 7301

Belorussia

Представительство ГРУНДФОС в
Минске
220123, Минск,
ул. В. Хоружий, 22, оф. 1105
Тел.: +(37517) 233 97 65,
Факс: +(37517) 233 97 69
E-mail: grundfos_minsk@mail.ru

Bosnia/Herzegovina

GRUNDFOS Sarajevo
Trg Heroja 16,
BIH-71000 Sarajevo
Phone: +387 33 713 290
Telefax: +387 33 659 079
e-mail: grundfos@bih.net.ba

Brazil

BOMBAS GRUNDFOS DO BRASIL
Av. Humberto de Alencar Castelo Branco,
630
CEP 09850 - 300
São Bernardo do Campo - SP
Phone: +55-11 4393 5533
Telefax: +55-11 4343 5015

Bulgaria

Grundfos Bulgaria EOOD
Slatina District
Iztocna Tangenta street no. 100
BG - 1592 Sofia
Tel. +359 2 49 22 200
Fax. +359 2 49 22 201
email: bulgaria@grundfos.bg

Canada

GRUNDFOS Canada Inc.
2941 Brighton Road
Oakville, Ontario
L6H 6C9
Phone: +1-905 829 9533
Telefax: +1-905 829 9512

China

GRUNDFOS Pumps (Shanghai) Co. Ltd.
50/F Maxdo Center No. 8 XingYi Rd.
Hongqiao development Zone
Shanghai 200336
PRC
Phone: +86-021-612 252 22
Telefax: +86-021-612 253 33

Croatia

GRUNDFOS CROATIA d.o.o.
Cebini 37, Buzin
HR-10010 Zagreb
Phone: +385 1 6595 400
Telefax: +385 1 6595 499
www.grundfos.hr

Czech Republic

GRUNDFOS s.r.o.
Čajkovského 21
779 00 Olomouc
Phone: +420-585-716 111
Telefax: +420-585-716 299

Denmark

GRUNDFOS DK A/S
Martin Bachs Vej 3
DK-8850 Bjerringbro
Tlf.: +45-87 50 50 50
Telefax: +45-87 50 51 51
E-mail: info_GDK@grundfos.com
www.grundfos.com/DK

Estonia

GRUNDFOS Pumps Eesti OÜ
Peturiburi tee 92G
11415 Tallinn
Tel.: +372 606 1690
Fax: +372 606 1691

Finland

OY GRUNDFOS Pumput AB
Mestariintie 11
FIN-01730 Vantaa
Phone: +358-3066 5650
Telefax: +358-3066 5650

France

Pompes GRUNDFOS Distribution S.A.
Parc d'Activités de Chesnes
57, rue de Malacolombe
F-38290 St. Quentin Fallavier (Lyon)
Tel.: +33-4 74 82 15 15
Téléphone: +33-4 74 94 10 51

Germany

GRUNDFOS GMBH
Schillerstr. 33
40699 Erkirath
Tel.: +49-(0) 211 929 69-0
Telefax: +49-(0) 211 929 69-3799
e-mail: info@grundfos.de
Service in Deutschland:
e-mail: kundendienst@grundfos.de

Greece

GRUNDFOS Hellas E.A.B.E.E.
20th km. Athinon-Markopoulou Av.
P.O. Box 71
GR-19002 Peania
Phone: +0030-210-66 83 400
Telefax: +0030-210-66 46 273

Hong Kong

GRUNDFOS Pumps (Hong Kong) Ltd.
Unit 1, Ground floor
Siu Wai Industrial Centre
29-33 Wing Hong Street &
68 King Lam Street, Cheung Sha Wan
Kowloon
Phone: +852-27861706 / 27861714
Telefax: +852-27858664

Hungary

GRUNDFOS Hungária Kft.
Park u. 8
H-2045 Törökbálint,
Phone: +36-23 511 110
Telefax: +36-23 511 111

India

GRUNDFOS Pumps India Private Limited
118 Old Mahabaliapuram Road
Thoraipakkam
Chennai 600 096
Phone: +91-44 2496 6800

Indonesia

PT GRUNDFOS Pompa
Jl. Rawa Sumur III, Blok III / CC-1
Kawasan Industri, Pulogadung
Jakarta 13530
Phone: +62-21-460 6909
Telefax: +62-21-460 6910 / 460 6901

Ireland

GRUNDFOS (Ireland) Ltd.
Unit A, Merynwell Business Park
Ballinacourt Road Lower
Dublin 12
Phone: +353-1-4089 800
Telefax: +353-1-4089 830

Italy

GRUNDFOS Pompe Italia S.r.l.
Via Gran Sasso 4
I-20060 Trucuzzano (Milano)
Tel.: +39-02-95838112
Telefax: +39-02-95309290 / 95838461

Japan

GRUNDFOS Pumps K.K.
Gotanda Metalon Bldg., 5F,
5-21-15, Higashi-gotanda
Shiagawa-ku, Tokyo
141-0022 Japan
Phone: +81 35 448 1391
Telefax: +81 35 448 9619

Korea

GRUNDFOS Pumps Korea Ltd.
6th Floor, Aju Building 679-5
Yeoksam-dong, Kangnam-ku, 135-916
Seoul, Korea
Phone: +82-2-5317 600
Telefax: +82-2-5633 725

Latvia

SIA GRUNDFOS Pumps Latvia
Deglava biznesa centrs
Augusta Dzelgala iela 60, LV-1035, Rīga,
Tālr.: + 371 714 9640, 7 149 641
Fakss: + 371 914 9646

Lithuania

GRUNDFOS Pumps UAB
Smolensko g. 6
LT-03201 Vilnius
Tel: + 370 52 395 430
Fax: + 370 52 395 431

Malaysia

GRUNDFOS Pumps Sdn. Bhd.
7 Jalan Peguam U1/25
Glenmarie Industrial Park
40150 Shah Alam
Selangor
Phone: +60-3-5569 2922
Telefax: +60-3-5569 2866

México

Bombas GRUNDFOS de México S.A. de
C.V.
Boulevard TLC No. 15
Parque Industrial Stiva Aeropuerto
Apodaca, N.L. 66600
Phone: +52-81-8144 4000
Telefax: +52-81-8144 4010

Netherlands

GRUNDFOS Netherlands
Veluwezoom 35
1326 AE Almere
Postbus 22015
1302 CA ALMERE
Tel.: +31-86-478 6336
Telefax: +31-86-478 6332
e-mail: info_grl@grundfos.com

New Zealand

GRUNDFOS Pumps NZ Ltd.
17 Beatrice Tinley Crescent
North Harbour Industrial Estate
Albany, Auckland
Phone: +64-9-415 3240
Telefax: +64-9-415 3250

Norway

GRUNDFOS Pumper A/S
Strømsveien 344
Postboks 225, Leirdal
N-1011 Oslo
Tlf.: +47-22-90 47 00
Telefax: +47-22-32 21 50

Poland

GRUNDFOS Pompy Sp. z o.o.
ul. Klonowa 23
Baranowo k. Poznania
Pl.-62-081 Przewitkowo
Tel: (+48-61) 650 13 00
Fax: (+48-61) 650 13 50

Portugal

Bombas GRUNDFOS Portugal, S.A.
Rua Calvet de Magalhães, 241
Apartado 1079
P-2770-155 Paço de Arcos
Tel.: +351-21-440 76 00
Telefax: +351-21-440 76 90

România

GRUNDFOS Pompe România SRL
Bd. Biruintei, nr 103
Pantelimon county Ifov
Phone: +40 21 200 4100
Telefax: +40 21 200 4101
E-mail: romania@grundfos.ro

Russia

ООО Грундфос
Пронский, 109544 Москва, ул. Школьная 39
Тел. (+7) 495 737 30 00, 564 88 00
Факс (+7) 495 737 75 36, 564 88 11
E-mail grundfos.moscow@grundfos.com

Serbia

GRUNDFOS Predstavništvo Beograd
Dr. Milutina Ivkovića 2a/29
YU-11000 Beograd
Phone: +381 11 26 47 877 / 11 26 47 496
Telefax: +381 11 26 48 340

Singapore

GRUNDFOS (Singapore) Pte. Ltd.
24 Tuas West Road
Jurong Town
Singapore 638381
Phone: +65-6865 1222
Telefax: +65-6861 8402

Slovenia

GRUNDFOS d.o.o.
Štandrova 8b, SI-1231 Ljubljana-Črnuče
Phone: +386 1 568 0610
Telefax: +386 1 568 0619
E-mail: slovenia@grundfos.si

South Africa

Corner Mountjoy and George Allen Roads
Wilbart Ext. 2
Bedfordview 2079
Phone: (+27) 11 579 4800
Fax: (+27) 11 455 6066
E-mail: Ismart@grundfos.com

Spain

Bombas GRUNDFOS España S.A.
Camino de la Fuenteicela, s/n
E-28110 Algete (Madrid)
Tel.: +34-91-848 8800
Telefax: +34-91-628 0465

Sweden

GRUNDFOS AB
Box 333 (Lunagårdsgatan 6)
431 24 Mölndal
Tel.: +46(0)71-32 23 00
Telefax: +46(0)71-321 94 60

Switzerland

GRUNDFOS Pumpen AG
Bruggacherstrasse 10
CH-8117 Fallanden/ZH
Tel.: +41-1-806 8111
Telefax: +41-1-806 8115

Taiwan

GRUNDFOS Pumps (Taiwan) Ltd.
7 Floor, 219 Min-Chuan Road
Taichung, Taiwan, R.O.C.
Phone: +886-4-2305 0868
Telefax: +886-4-2305 0878

Thailand

GRUNDFOS (Thailand) Ltd.
92 Chaloom Phrakiat Rama 9 Road,
Dokmai, Pravej, Bangkok 10250
Phone: +66-2-725 8799
Telefax: +66-2-725 8998

Turkey

GRUNDFOS POMPA San. ve Tic. Ltd. Sti.
Gebze Organize Sanayi Bölgesi
İhsan dede Caddeşi,
2. yöl 200, Sokak No. 204
41450 Gebze/ Kocaeli
Phone: +90 - 262-679 7979
Telefax: +90 - 262-679 7905
E-mail: satis@grundfos.com

UKRAINE

ТОВ ГРУНДФОС УКРАЇНА
01010 Київ, Вул. Московська 86,
Тел: (+38 044) 390 40 50
Факс: (+38 044) 390 40 59
E-mail: ukraine@grundfos.com

United Arab Emirates

GRUNDFOS Gulf Distribution
P.O. Box 16768
Jebel Ali Free Zone
Dubai
Phone: +971-4- 8815 166
Telefax: +971-4-8815 136

United Kingdom

GRUNDFOS Pumps Ltd.
Grovebury Road
Leighton Buzzard/Beds. LU7 8TL
Phone: +44-1525-850000
Telefax: +44-1525-850011

U.S.A.

GRUNDFOS Pumps Corporation
17100 West 118th Terrace
Olathe, Kansas 66061
Phone: +1-913-227-3400
Telefax: +1-913-227-3500

Usbekistan

Представительство ГРУНДФОС в
Ташкенте
700000 Ташкент ул.Усмани Носири 1-й
тулик 5
Телефон: (3712) 55-68-15
Факс: (3712) 53-36-35

| |
|----------------------|
| 96434870 0710 |
| Repl. 96434870 0405 |

30

ECM: 1063232

The name Grundfos, the Grundfos logo, and the payoff Be–Think–Innovate are registered trademarks owned by Grundfos Management A/S or Grundfos A/S, Denmark. All rights reserved worldwide.
